

Candor Schools

Candor, New York



AIR TEMP HEATING & AIR CONDITIONING, INC. **A LINC SERVICE ® CONTRACTOR**

1165 Front Street
Binghamton, New York 13905

Phone Number: (607)772-8362

Fax Number: (607)771-8470


Engineer/Architect Highland Associates

Mechanical Contractor J&K Plumbing and Heating


Job Number P7793

Table of Contents


- 1: Titlepage
- 2: Table of Contents
- 3: Symbol Legend
- 4: Summary Bill of Materials
- 5: Riser
- 6: Riser 2
- 7: Boiler Plant High School
- 8: Boiler Plant Elementary School
- 9: Unit Ventilators H.S.
- 10: Unit Ventilators E.S.
- 11: RTU 1S Shop H.S.
- 12: RTU 2 Auditorium H.S.
- 13: RTU 7&8 Gym H.S.
- 14: RTU 8S Weight Room H.S.
- 15: RTU Cafeteria H.S.
- 16: RTU 1S Cafe E.S.
- 17: RTU MP RM E.L.
- 18: FC-1 H.S.
- 19: VAV H.S.
- 20: Domestic Boiler Fresh Air
- 21: Valve Schedule
- 22: Damper Schedule

Candor Schools Candor, New York			
 AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE © CONTRACTOR			
Table of Contents			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATEDLOGIC CORPORATION			CHECK BY: RSL
			DSCODE: 07112.00
			2 of 26

Symbol Legend



Supply Fan




DX Cooling Coil



Duct Temperature Sensor



Exhaust Fan



Electric Heating Coil




Averaging Duct Temperature Sensor




Return Fan



Gas Heating




Duct Humidity Sensor




Fan w/ Inlet Vane Control




Hot Water Heating Coil




Immersion Temperature Sensor w/ Well




Pump



Chilled Water Cooling Coil




Pressure Sensor




Room Temperature Sensor




Steam Heating Coil




Filter




Room Humidity Sensor




3 - Way Valve




Air Flow Station




FreezeStat




2 - Way Valve



Damper



Smoke Detector




Flow Sensor

Common Abbreviations:

AC - Air Conditioning	EVAP - Evaporator	SA - Supply Air
ACU - Air Conditioning Unit	F - Fahrenheit	SF - Supply Fan
AHU - Air Handling Unit	FCU - Fan Coil Unit	SP - Static Pressure
AI - Analog Input	HOA - Hand / Off / Auto	TEMP - Temperature
AO - Analog Output	HP - Heat Pump	UH - Unit Heater
AUTO - Automatic	HRU - Heat Recovery Unit	UV - Unit Ventilator
AUX - Auxiliary	HTEX - Heat Exchanger	VAV - Variable Air Volume
C - Common	HW - Hot Water	VVTU - Variable Volume Terminal Unit
CHW - Chilled Water	HWP - Hot Water Pump	W/ - with
CHWP - Chilled Water Pump	HWR - Hot Water Return	W/O - without
CHWR - Chilled Water Return	HWS - Hot Water Supply	WSHP - Water-Source Heat Pump
CHWS - Chilled Water Supply	MAX - Maximum	
COND - Condenser	MIN - Minimum	
CW - Condenser Water	MISC - Miscellaneous	
CWP - Condenser Water Pump	NC - Normally Closed	
CWR - Condenser Water Return	NO - Normally Open	
CWS - Condenser Water Supply	OA - Outdoor Air	
DA - Discharge Air	PIU - Powered Induction Unit	
DI - Digital Input	RA - Return Air	
DO - Digital Output	RF - Return Fan	
EA - Exhaust Air	RH - Relative Humidity	
EF - Exhaust Fan	RTU - Roof-top Unit	



General Notes:

1. All control modules are drawn using standard ALC module representations.
2. Electrical points are identified by a tagged method (LN# - LG - CM - EX - Z0):





- LN# - The line number (optional).
- LG - The gateway number (optional).
- CM - The control module address.
- EX - The expander module number.
- #1 - The channel number.

These tags include wiring for all AI's, DI's, AO's and DO's. Points using pneumatic tubing follow the same convention.


Candor Schools Candor, New York  A LINC SERVICE ® CONTRACTOR			
Symbol Legend			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			3 of 26

Summary Bill of Materials

Summary Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
A10k-d	DUCT TEMP SENSOR 10K-2	ALPS	A10K-2-D-8	4 ea
AAR	ARCNET TO ARCNET ROUTER	AUTOMATED LOGIC	AAR	2 ea
BAQ	CO2 SENSOR DUCT MOUNT	BAPI	BA/AQS-D8	6 ea
DA-CE	SR 0-10VDC 35 IN-LB 24 V	BELIMO	LF24-SR ALC	5 ea
DTS-D	DUCT 10K THERMISTOR PROBE 8 IN.	BAPI	ALC/10K-2-D-8	5 ea
FS-D	TEMP LOW LIMIT MAN. RESET DPDT	LANDIS STEAFA	1341504	87 ea
LGR25	LGR25	AUTOMATED LOGIC	LGR25	2 ea
Portal	PORTAL	AUTOMATED LOGIC	PORTAL	2 ea
REL-F	RIB PILOT RELAY SPDT 10AMP	KELE & ASSOC.	RIBU1C	1 ea
TR50	50 VA TRANSFORMER	FUNCTIONAL DEVICES	TR50VA	1 ea
U551	U551	AUTOMATED LOGIC	U551	5 ea
ZN220	ZN220	AUTOMATED LOGIC	ZN220	2 ea
ZN253	ZN253	AUTOMATED LOGIC	ZN253	0 ea
ZN551	ZN551	AUTOMATED LOGIC	ZN551	9 ea
rib	CURRENT SENSOR	FUNCTIONAL DEVICES	RIBXKF	6 ea
rsp	RSPL	ALC	RSPL	2 ea

Candor Schools Candor, New York			
 AIR TEMP HEATING & AIR CONDITIONING, INC. <small>A LINC SERVICE © CONTRACTOR</small>			
Summary Bill of Materials			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			4 of 26

Riser

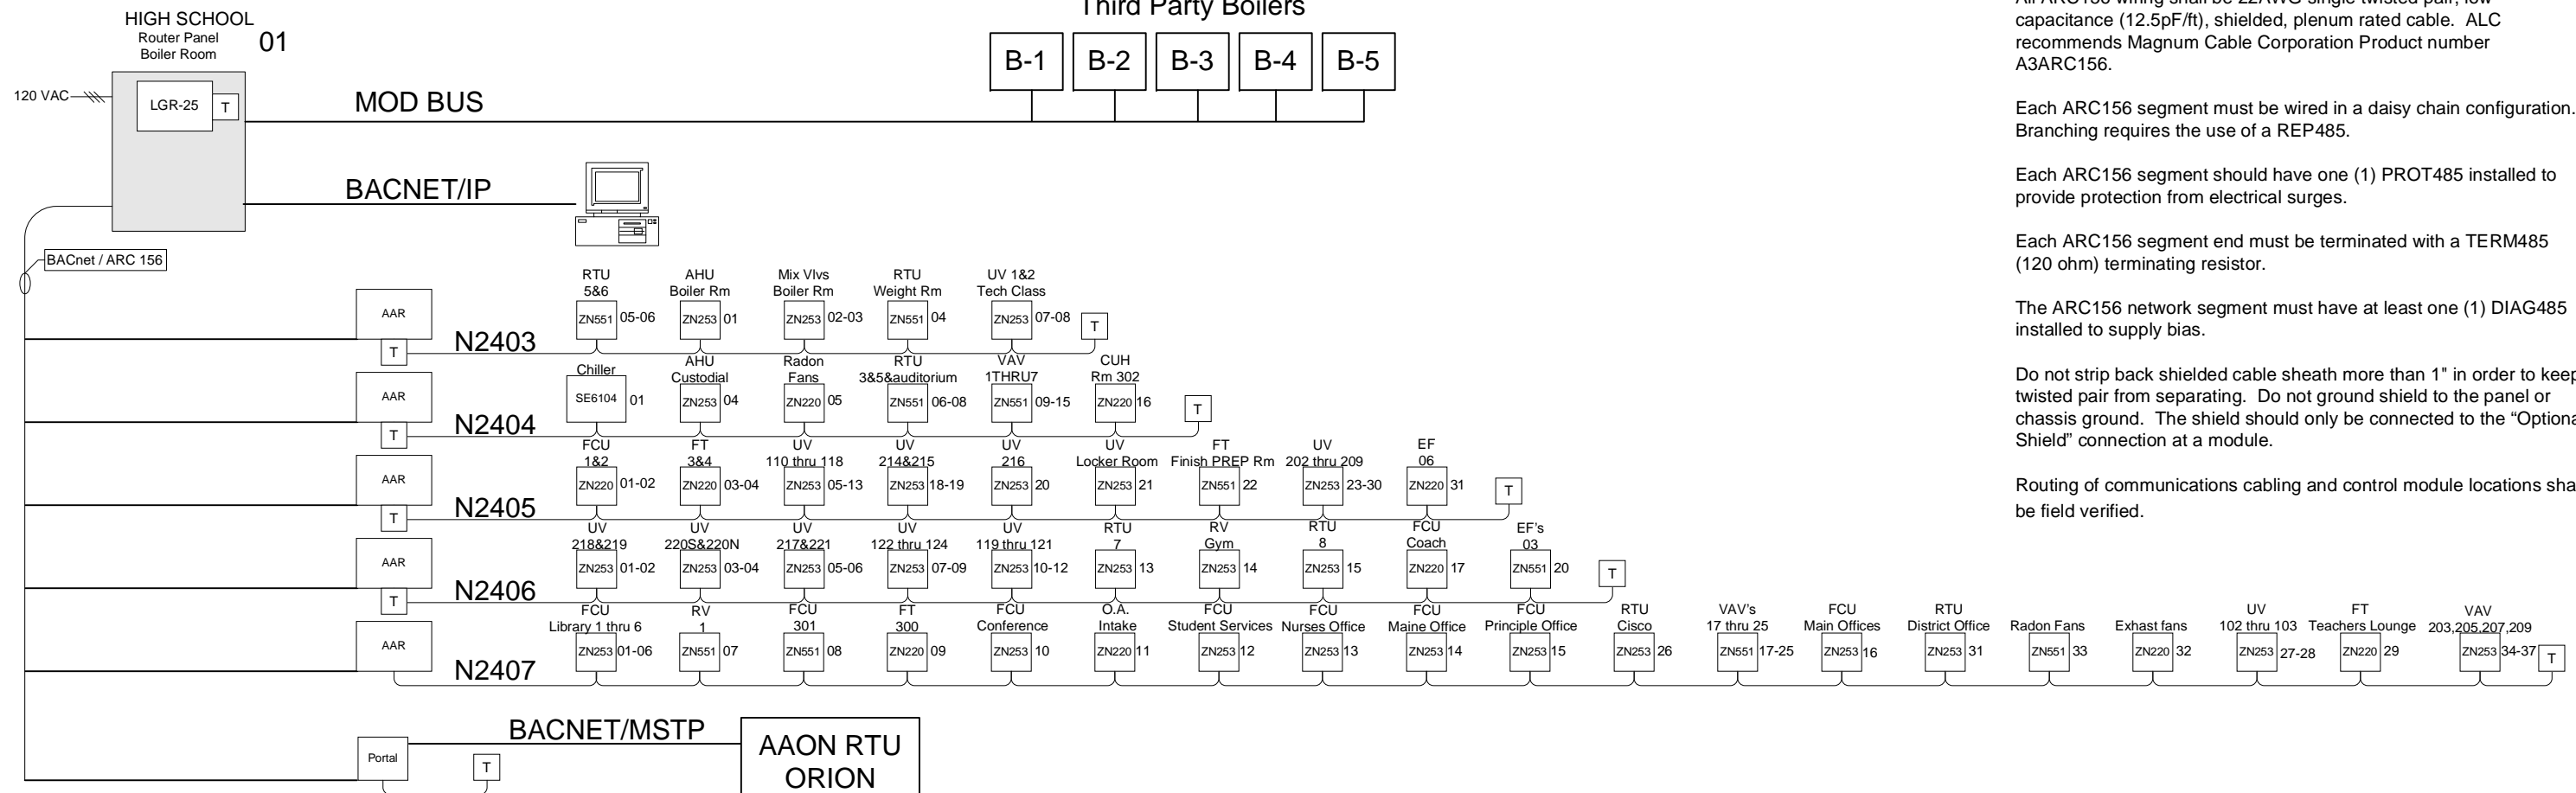

General Notes:

All ARC156 wiring shall be 22AWG single twisted pair, low capacitance (12.5pF/ft), shielded, plenum rated cable. ALC recommends Magnum Cable Corporation Product number A3ARC156.

Each ARC156 segment must be wired in a daisy chain configuration. Branching requires the use of a REP485.


Each ARC156 segment should have one (1) PROT485 installed to provide protection from electrical surges.

Each ARC156 segment end must be terminated with a TERM485 (120 ohm) terminating resistor.

The ARC156 network segment must have at least one (1) DIAG485 installed to supply bias.

Do not strip back shielded cable sheath more than 1" in order to keep twisted pair from separating. Do not ground shield to the panel or chassis ground. The shield should only be connected to the "Optional Shield" connection at a module.

Routing of communications cabling and control module locations shall be field verified.

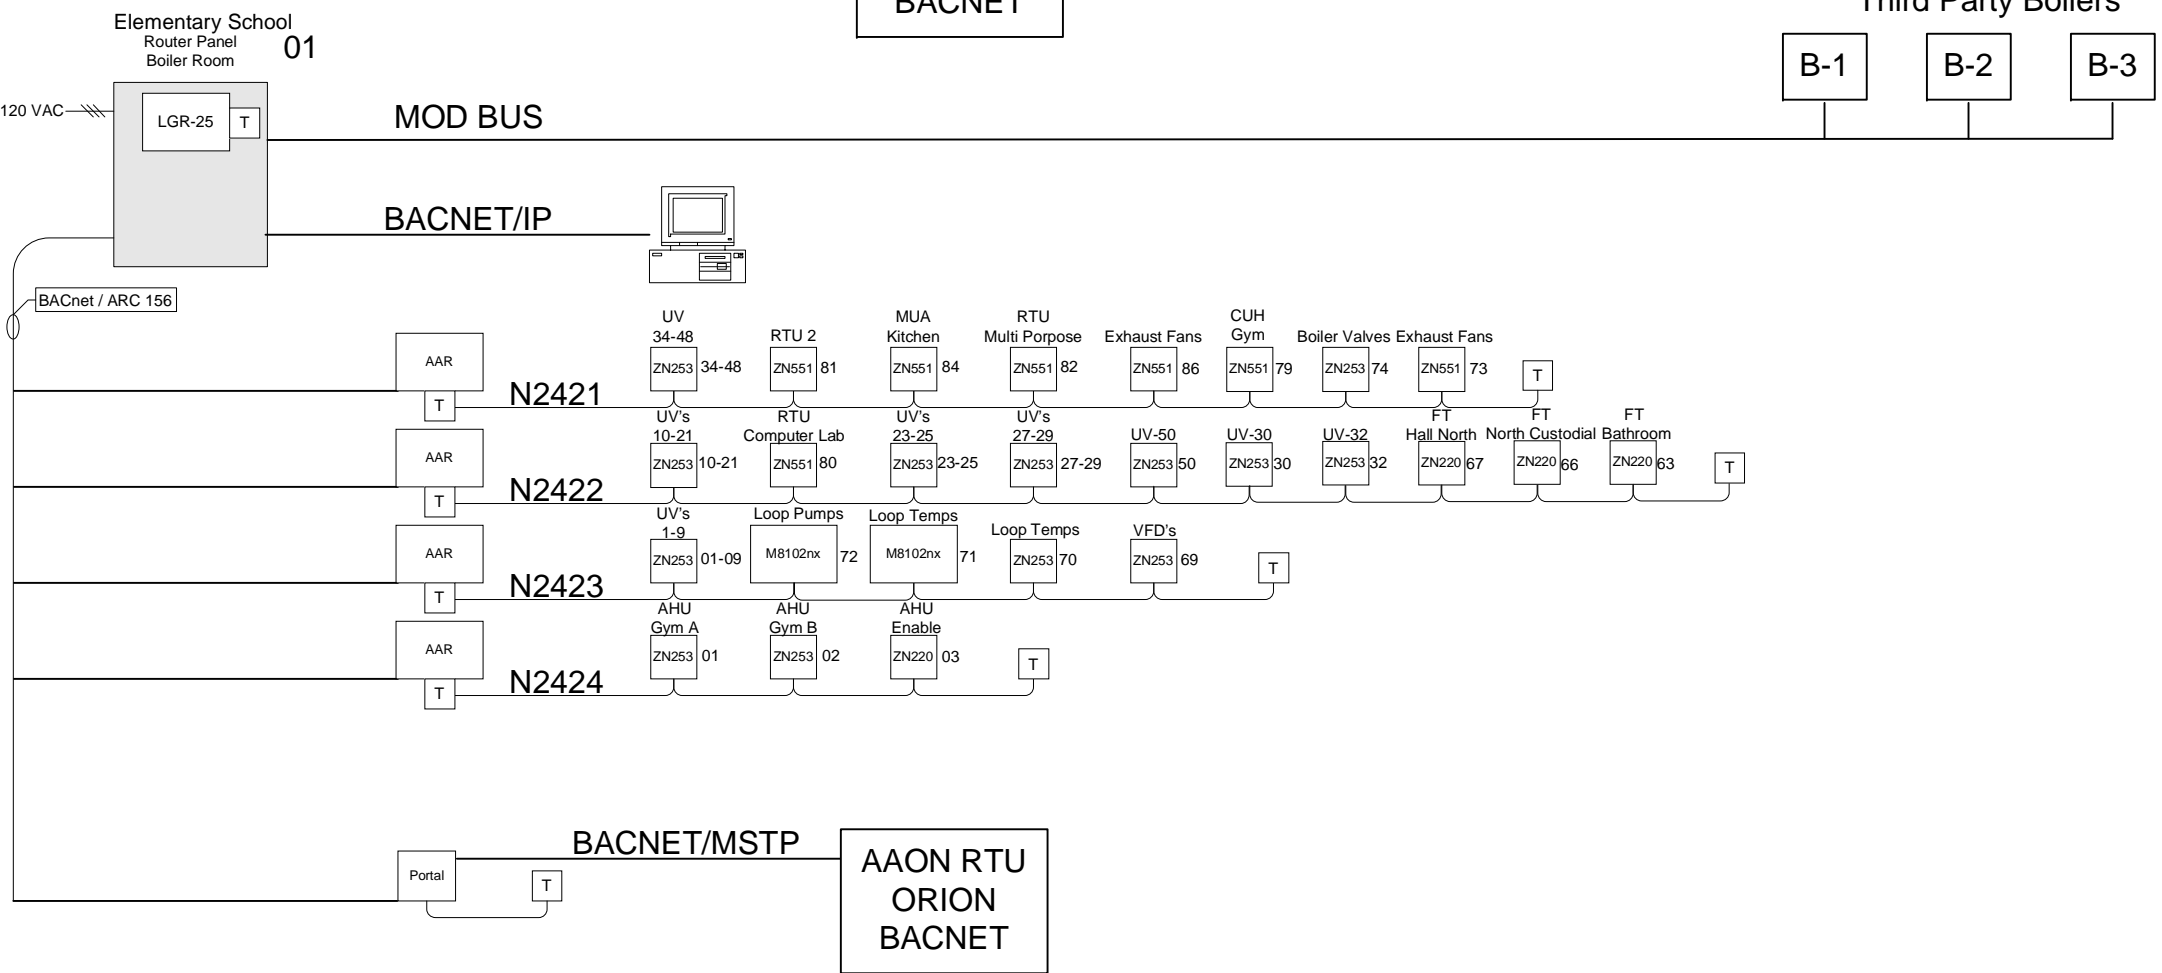


Candor Schools			
Candor, New York			
AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE ® CONTRACTOR			
Riser			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			5 of 26

Riser 2

Bill of Materials

DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
AAR	ARCNET TO ARCNET ROUTER	AUTOMATED LOGIC	AAR	2 ea
LGR25	LGR25	AUTOMATED LOGIC	LGR25	0 ea

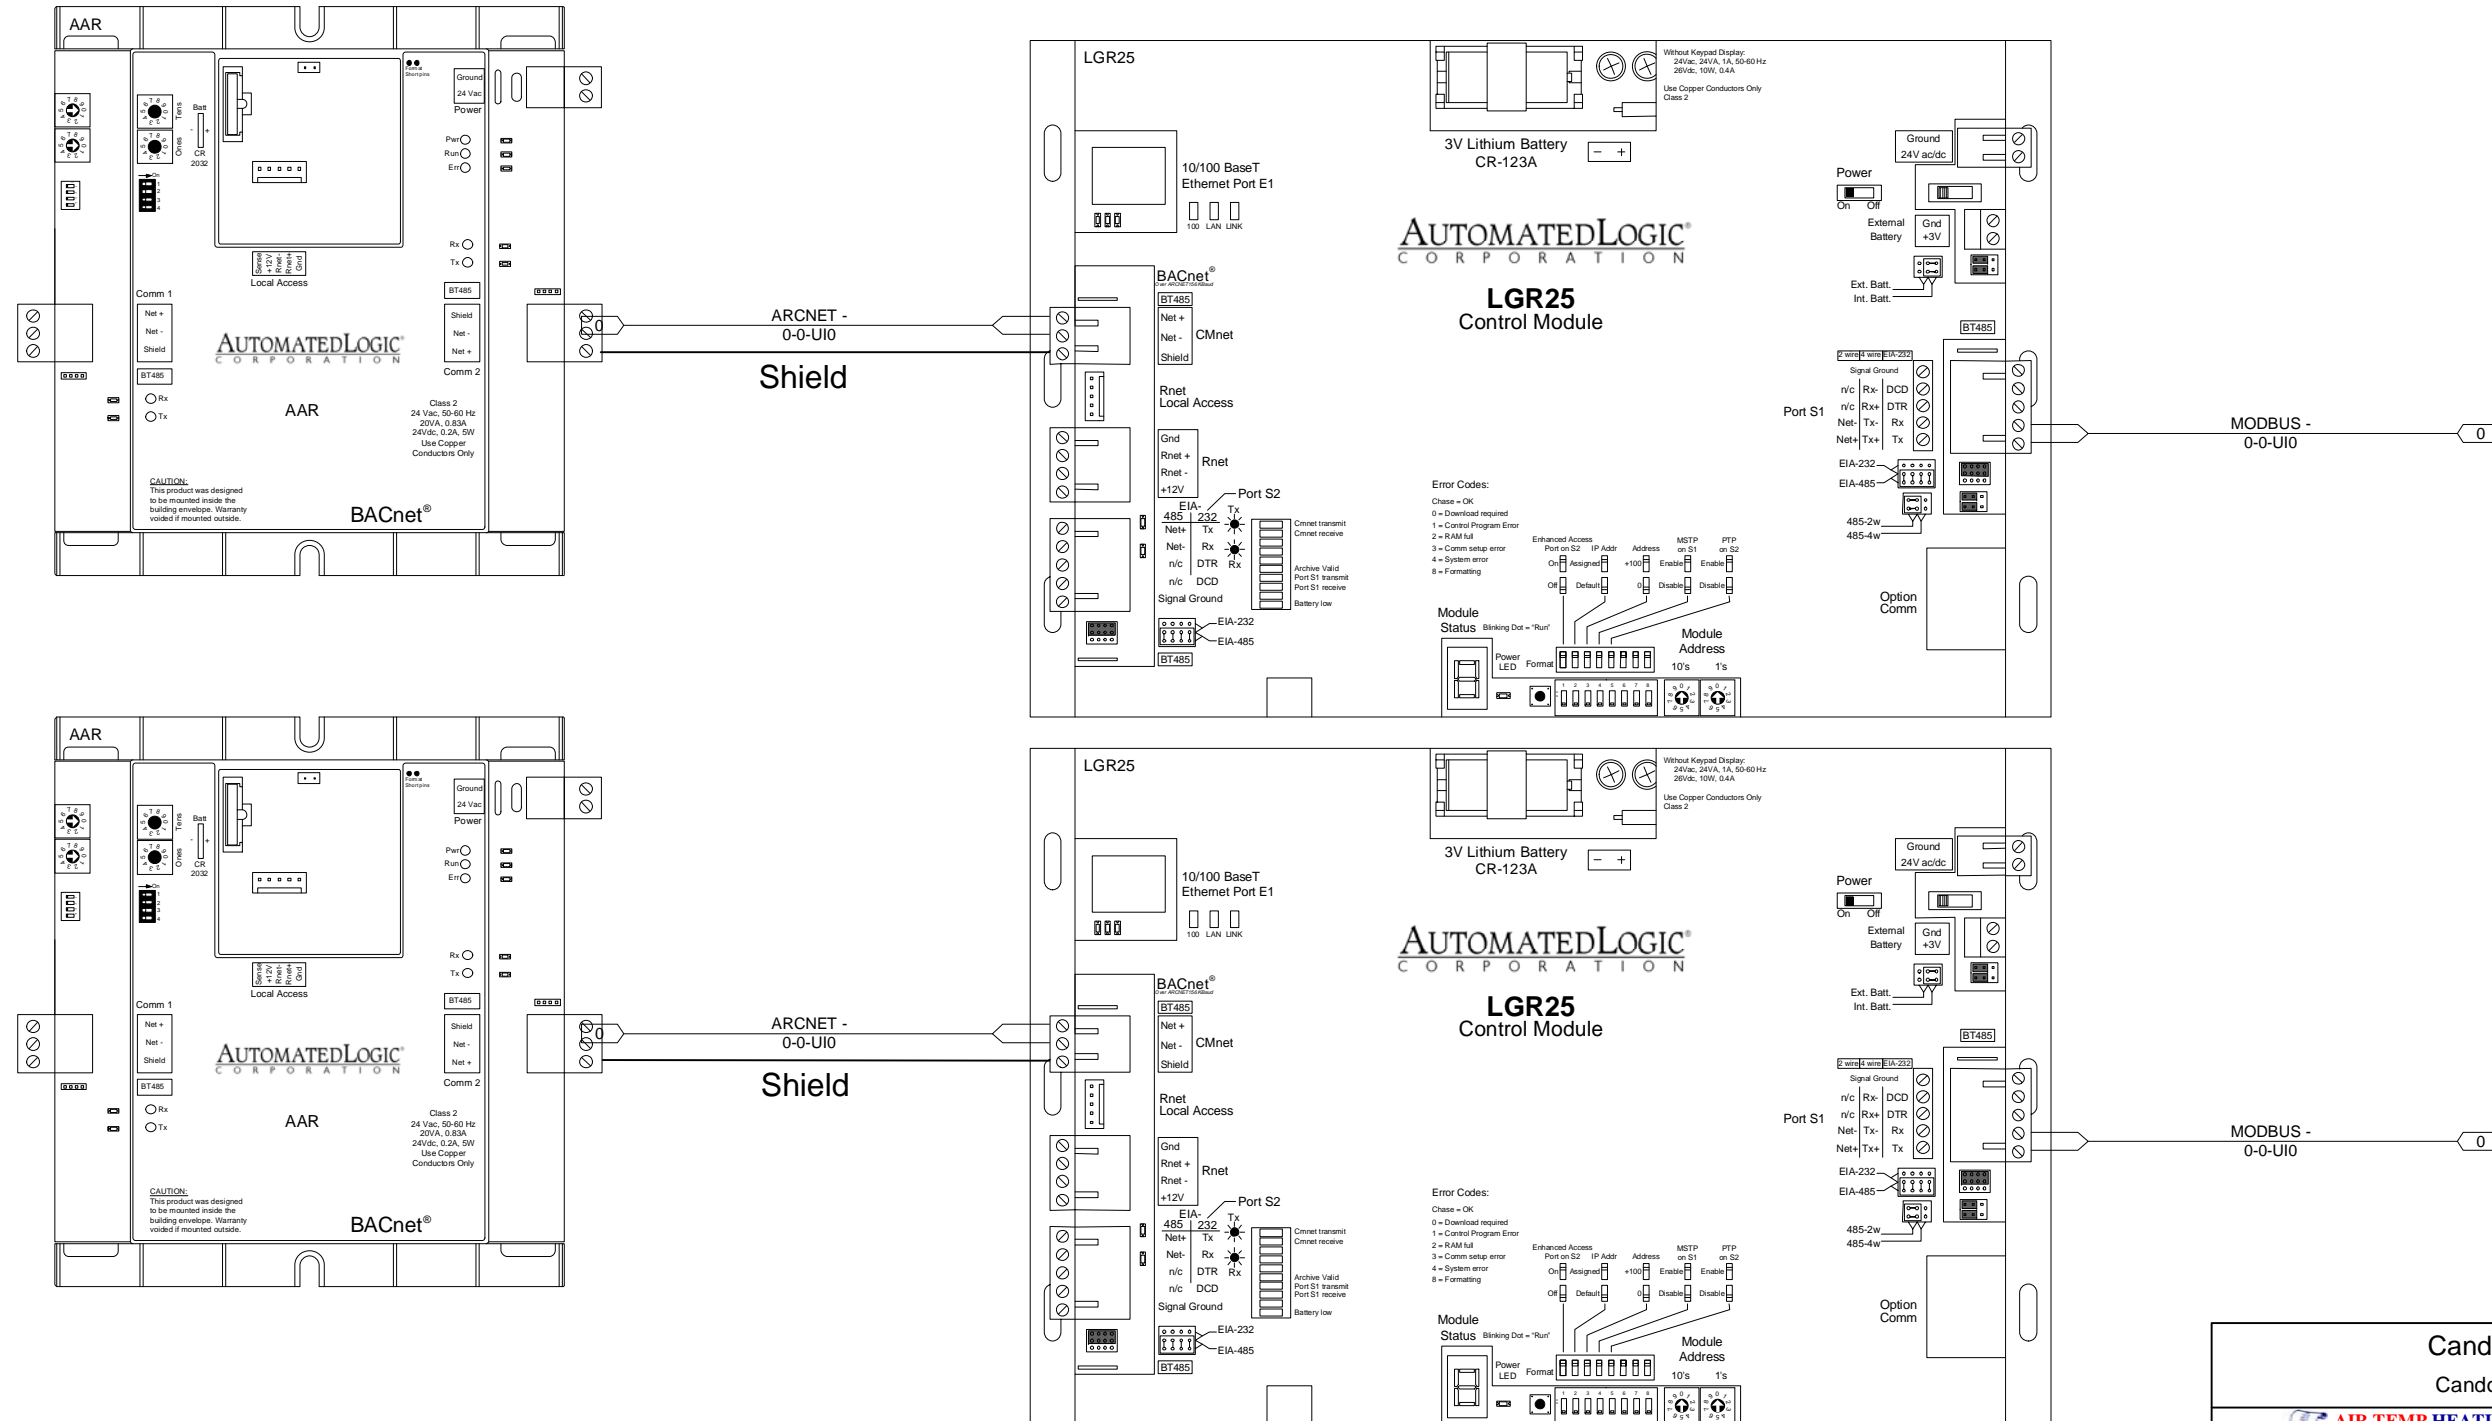

Candor Schools

Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR

Riser 2

REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

AUTOMATED LOGIC
CORPORATION


CHECK BY: RSL

DSCODE: 07112.00

Integration Heat Net to Existing Automated Logic


- Boiler 1 thru 5 Start/Stop
- Boiler 1 thru 5 Status
- Boiler 1 thru 5 Feed Pump
- Boiler 1 thru 5 Alarm
- Hot Water Supply Temp
- Hot Water Return Temp

Bill of Materials Schedule for Bill of Material				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
LGR25	LGR25	AUTOMATED LOGIC	LGR25	1 ea

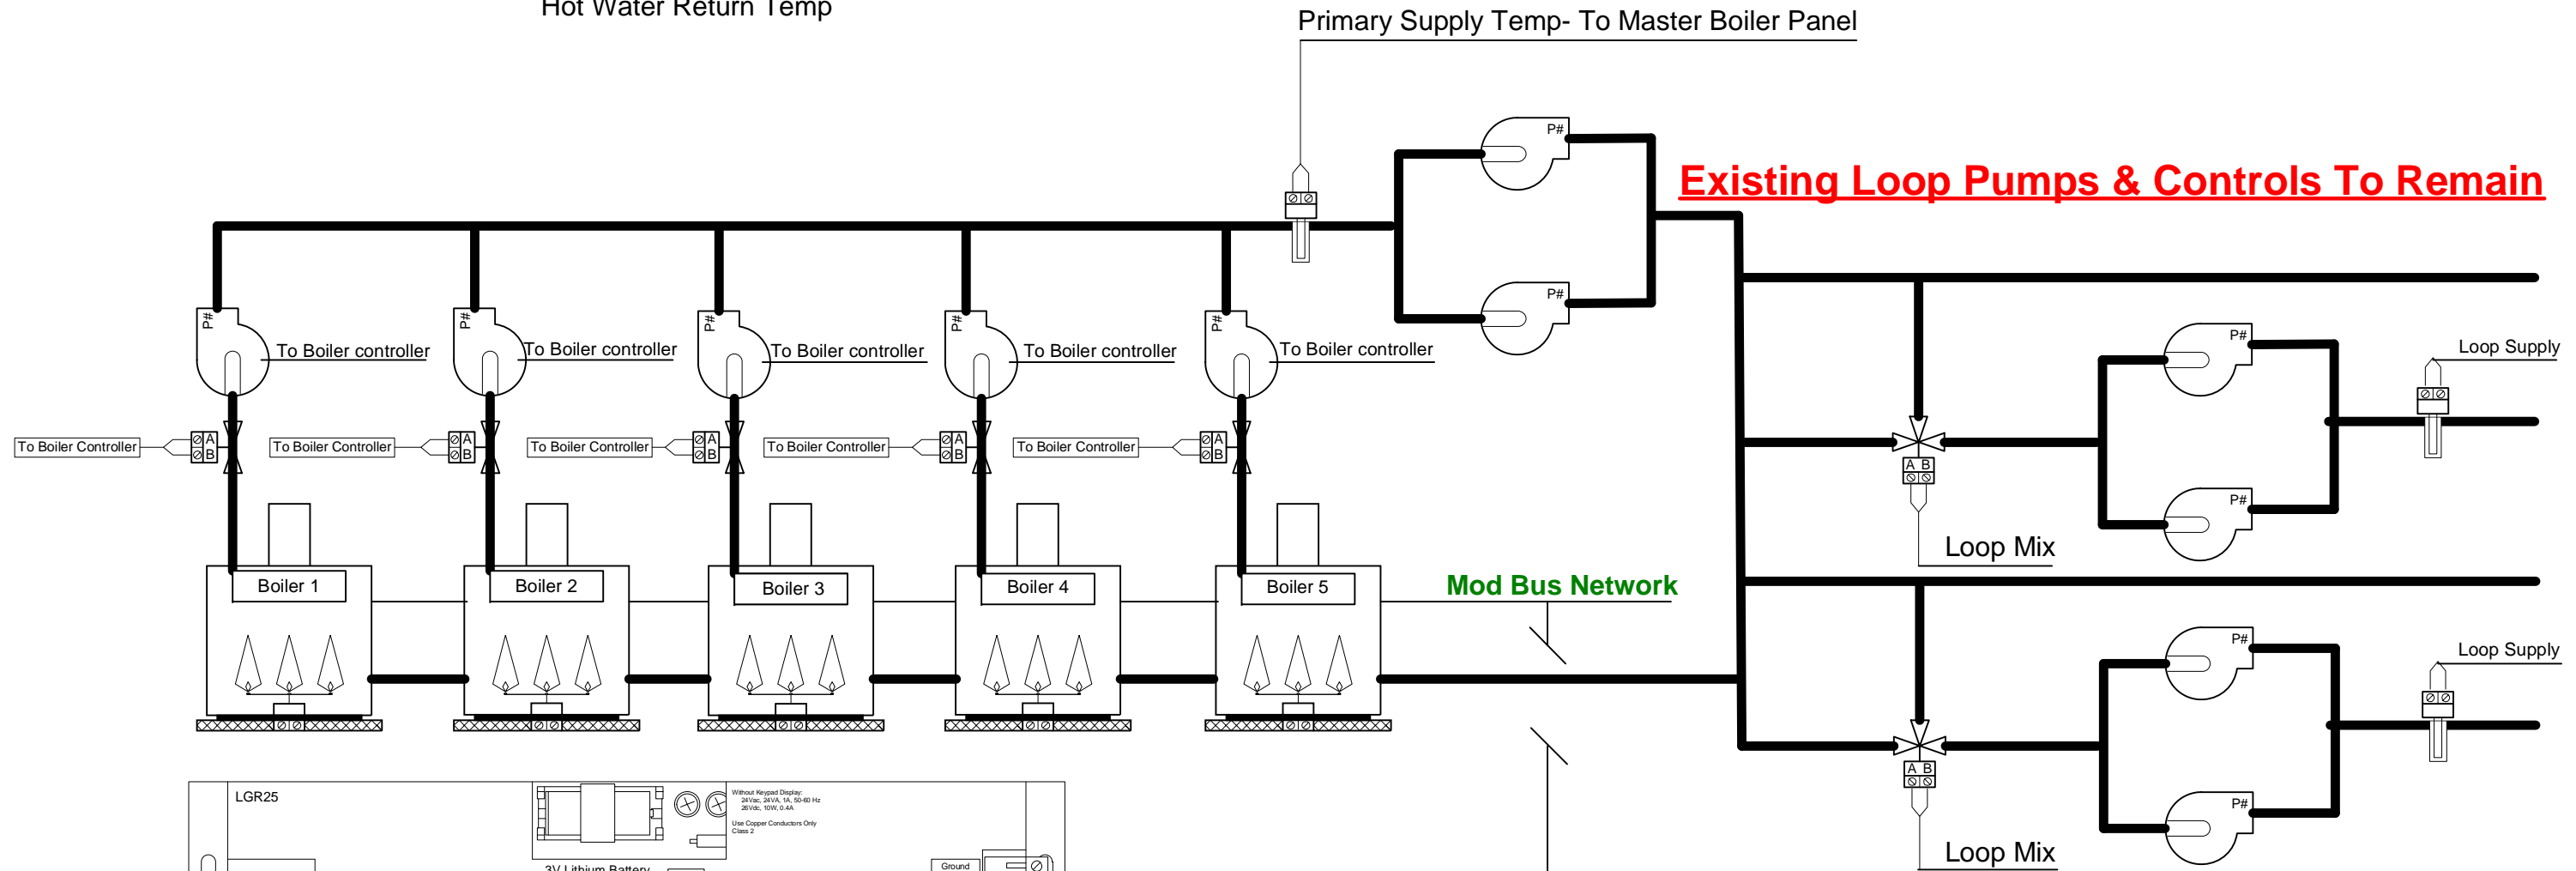

Existing Loop Pumps & Controls To Remain

Existing Loop Pumps & Controls To Remain

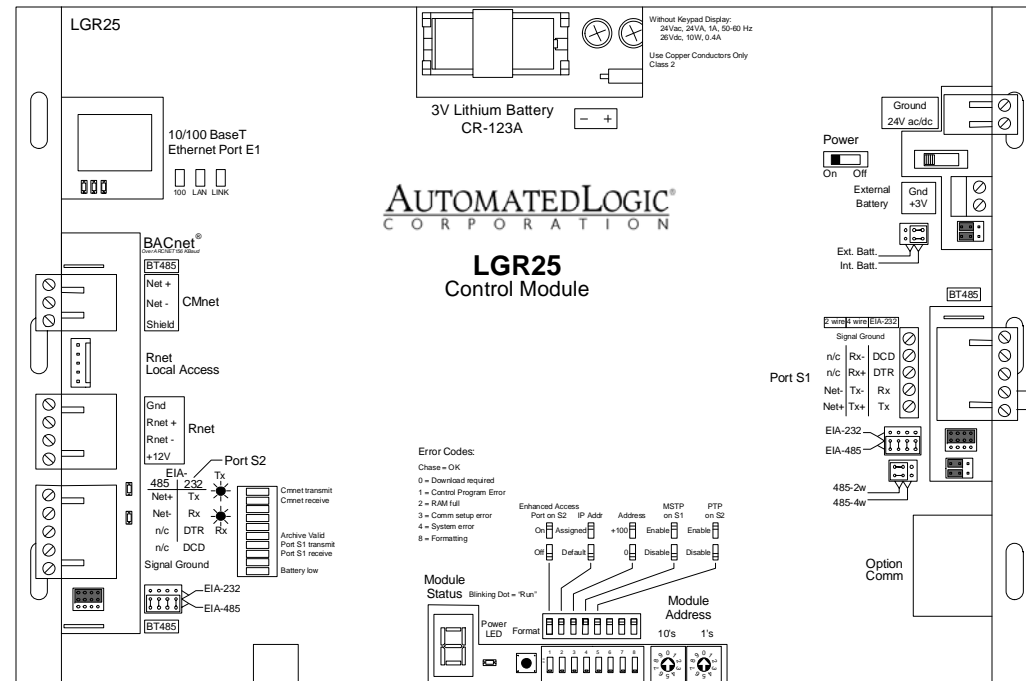

Mod Bus Network

Existing Programed Controls & Logic Include

- Heat loop Zone Pumps 6 thru 14
- Associated Mixing Valves
- Zone loop Supply Water Temperatures
- Zone loop Return Water Temperatures
- Outdoor Air Temperature

Candor Schools
Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR



Boiler Plant High School

REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATEDLOGIC CORPORATION			CHECK BY: RSL DSCODE: 07112.00
			7 of 26

Intigration Heat Net to Existing Automated Logic

- Boiler 1 thru 3 Start/Stop
- Boiler 1 thru 3 Status
- Boiler 1 thru 3 Feed Pump
- Boiler 1 thru 3 Alarm
- Hot Water Supply Temp
- Hot Water Return Temp

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
LGR25	LGR25	AUTOMATED LOGIC	LGR25	1 ea

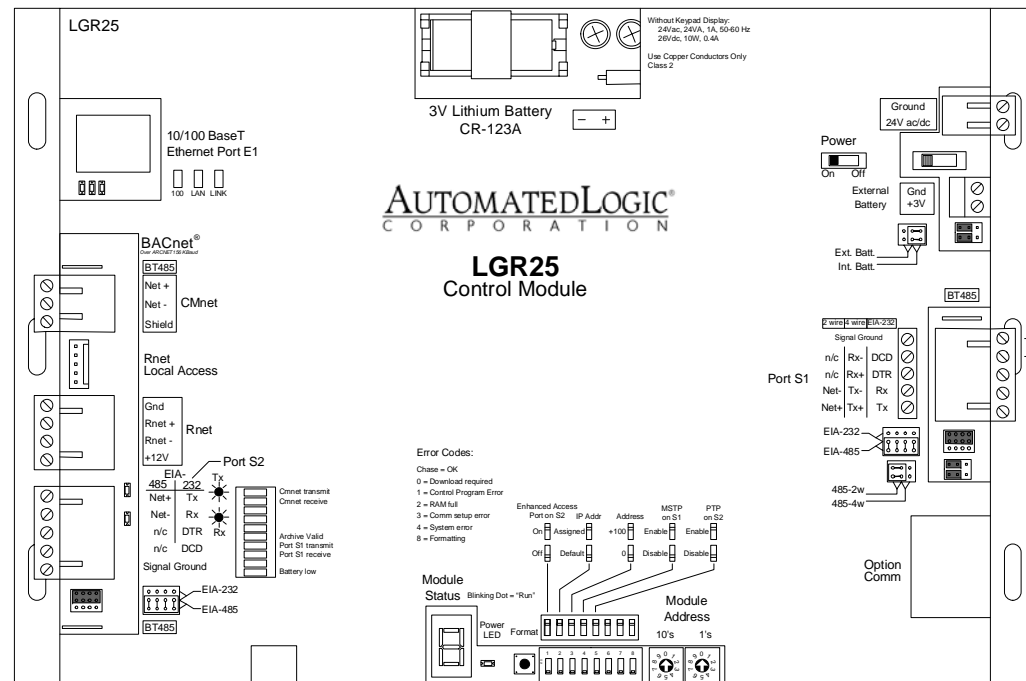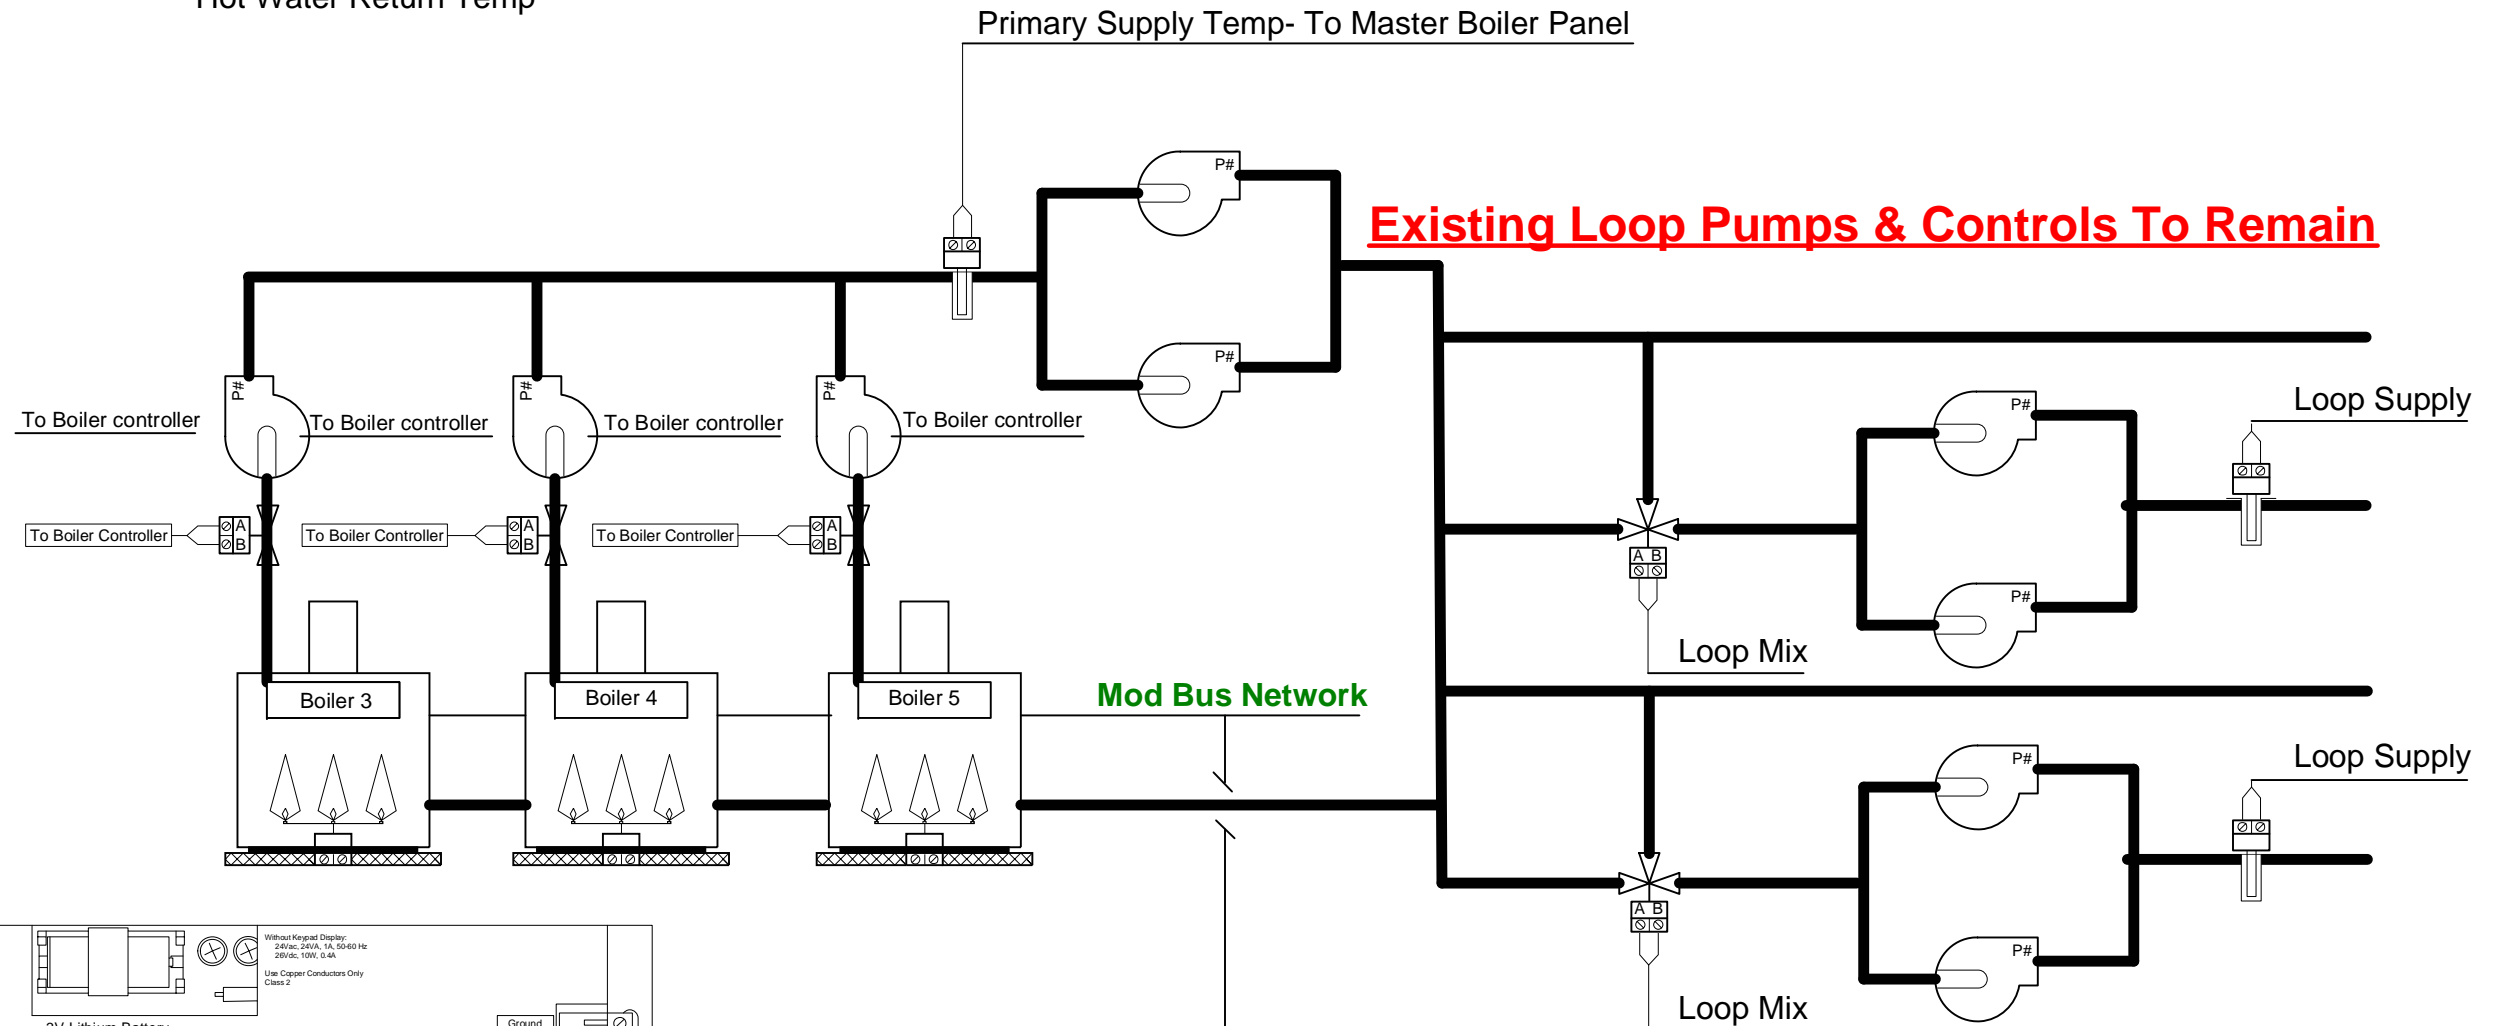

Mod Bus Network

Existing Programed Controls & Logic Include


- Heat loop Zone Pumps
- Associated Mixing Valves
- Zone loop Supply Water Temperatures
- Zone loop Return Water Temperatures
- Outdoor Air Temperature

Candor Schools Candor, New York			
 A LINC SERVICE @ CONTRACTOR			
Boiler Plant Elementary School			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
8 of 26			


Unit Ventilators H.S.

Typical For 42 Existing Unit Ventilators

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
FS-D	TEMP LOW LIMIT MAN. RESET DPDT	LANDIS STEAFA	1341504	42 ea
ZN253	ZN253	AUTOMATED LOGIC	ZN253	0 ea

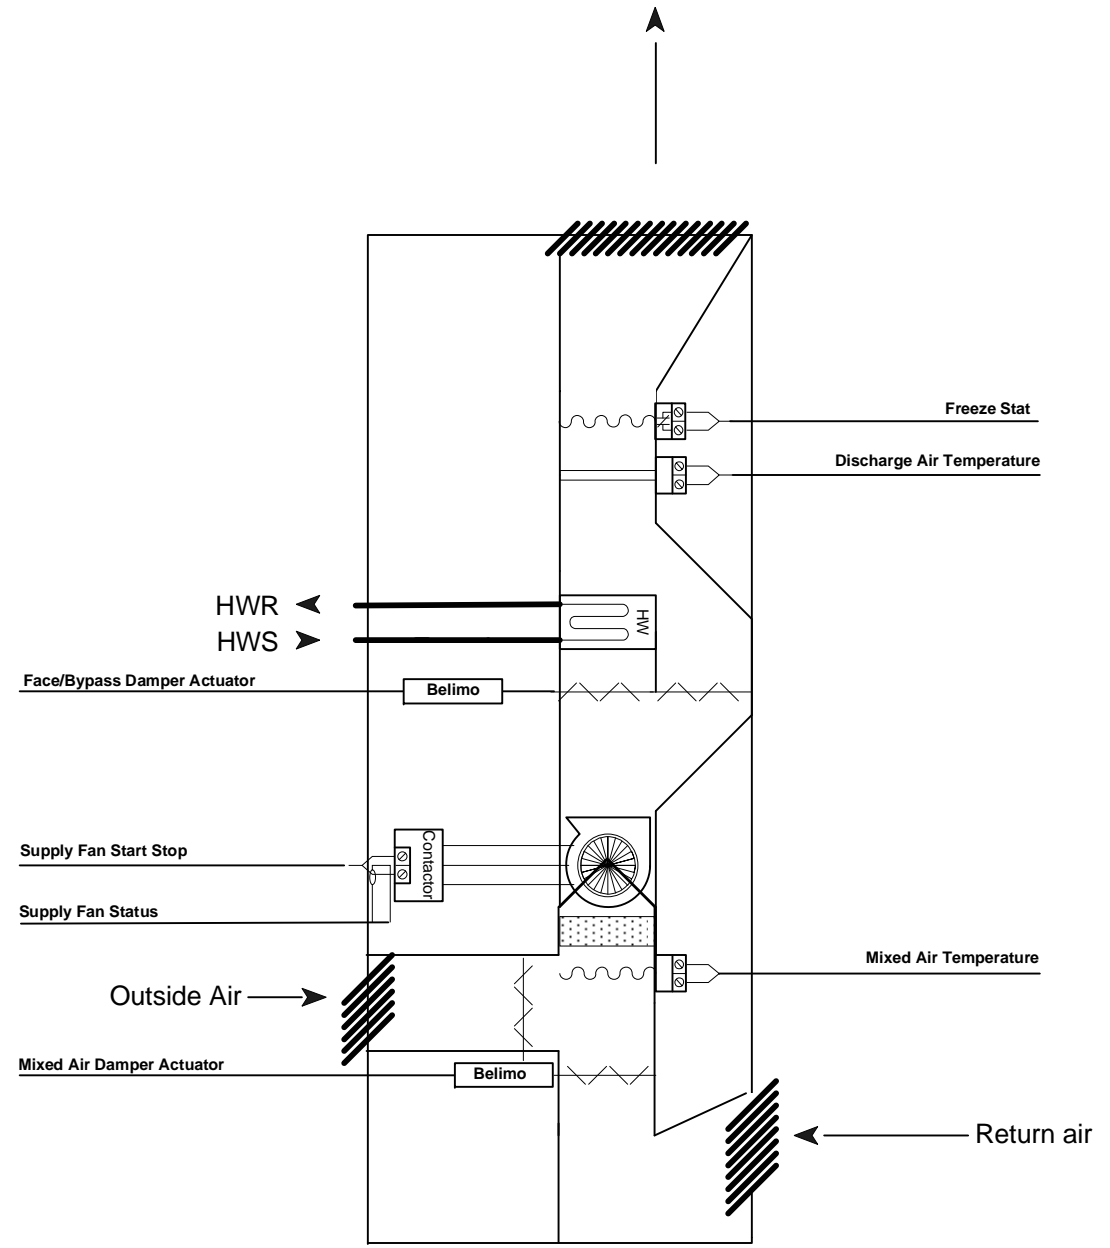

Added Control Upgrades Existing Controls

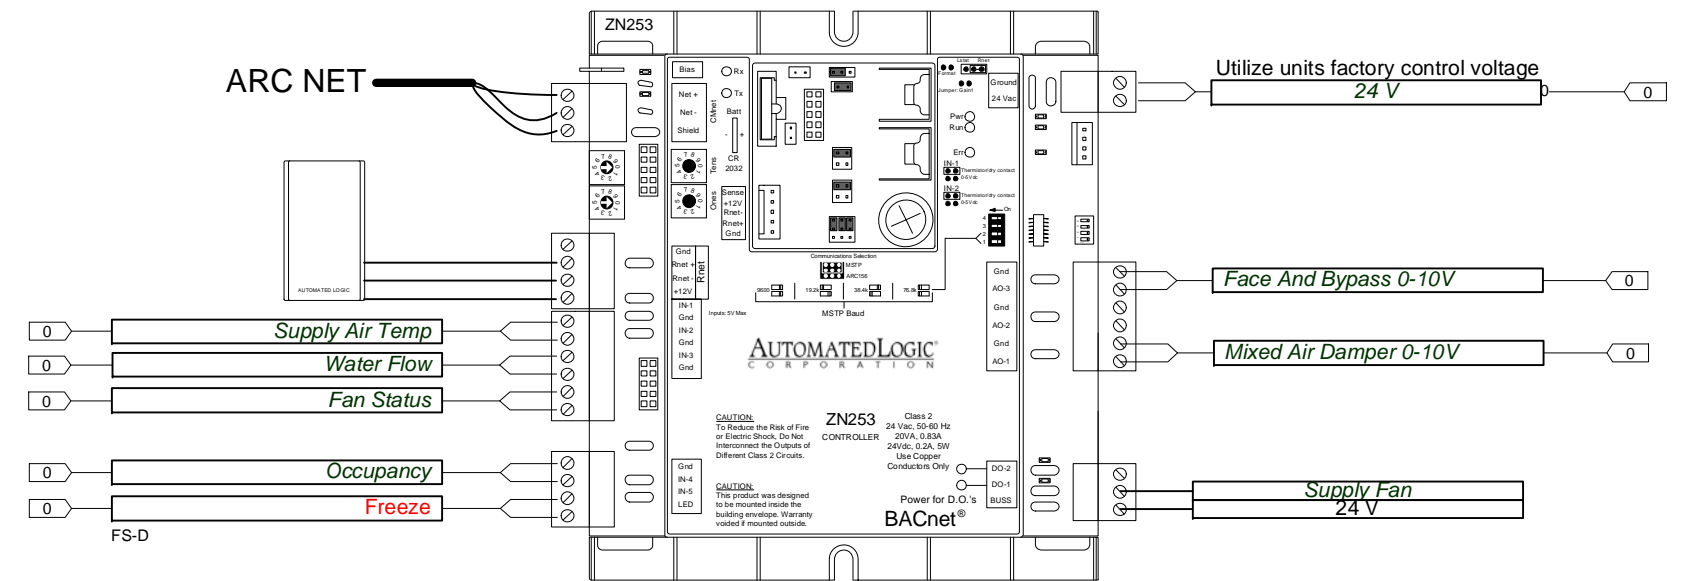

Candor Schools
Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR

Unit Ventilators H.S.


REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATED LOGIC CORPORATION			CHECK BY: RSL
			DSCODE: 07112.00

9 of 26


Unit Ventilators E.S.

Typical For 45 Existing Unit Ventilators

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
FS-D	TEMP LOW LIMIT MAN. RESET DPDT	LANDIS STEAFA	1341504	45 ea
ZN253	ZN253	AUTOMATED LOGIC	ZN253	0 ea

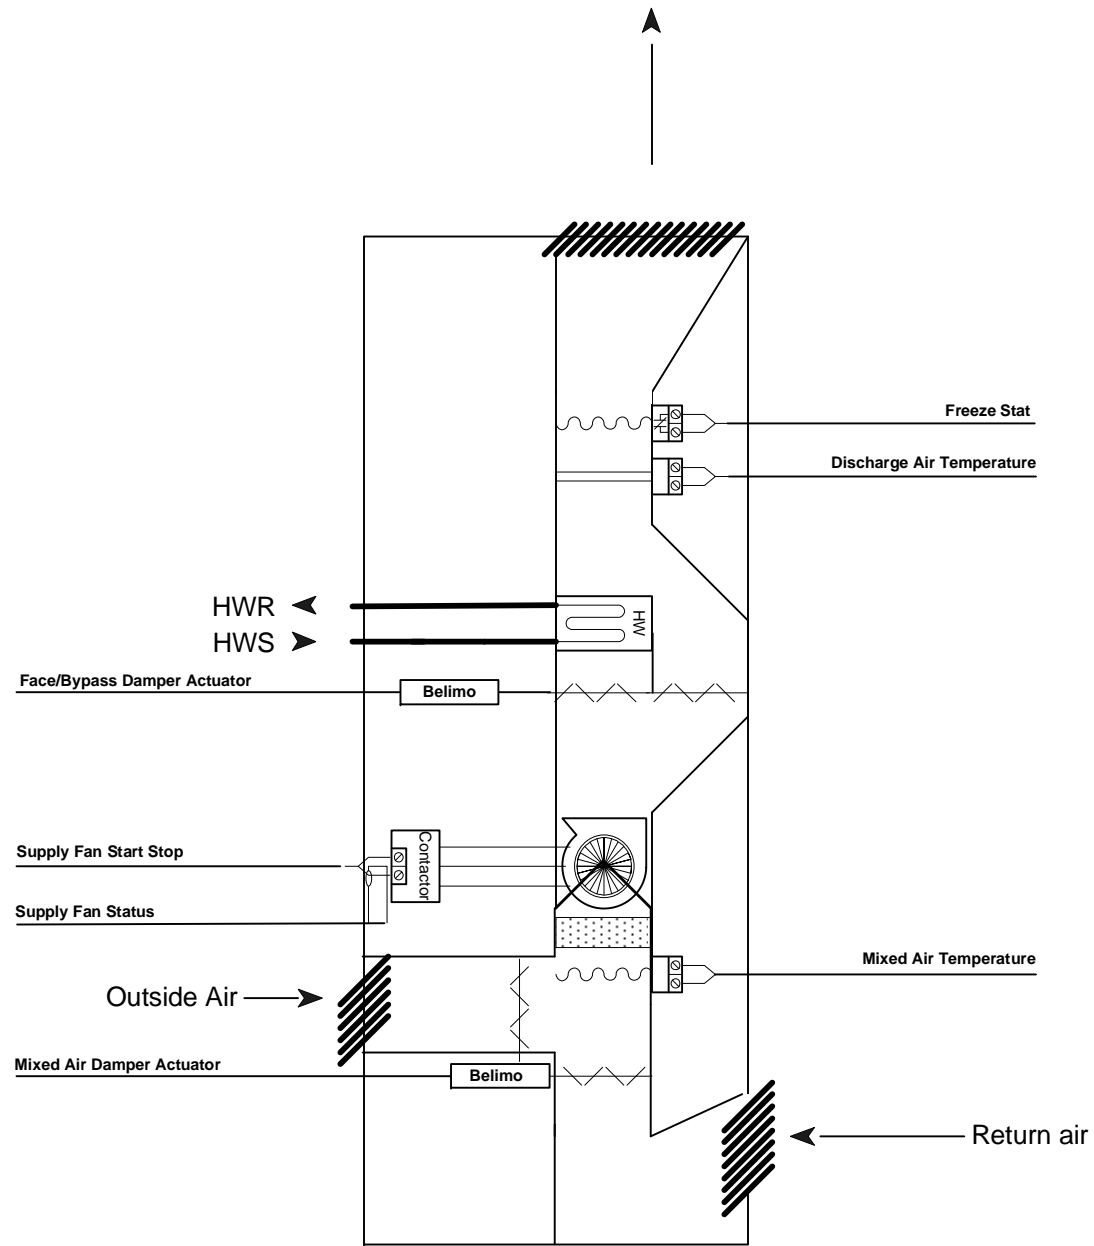

Added Control Upgrades Existing Controls

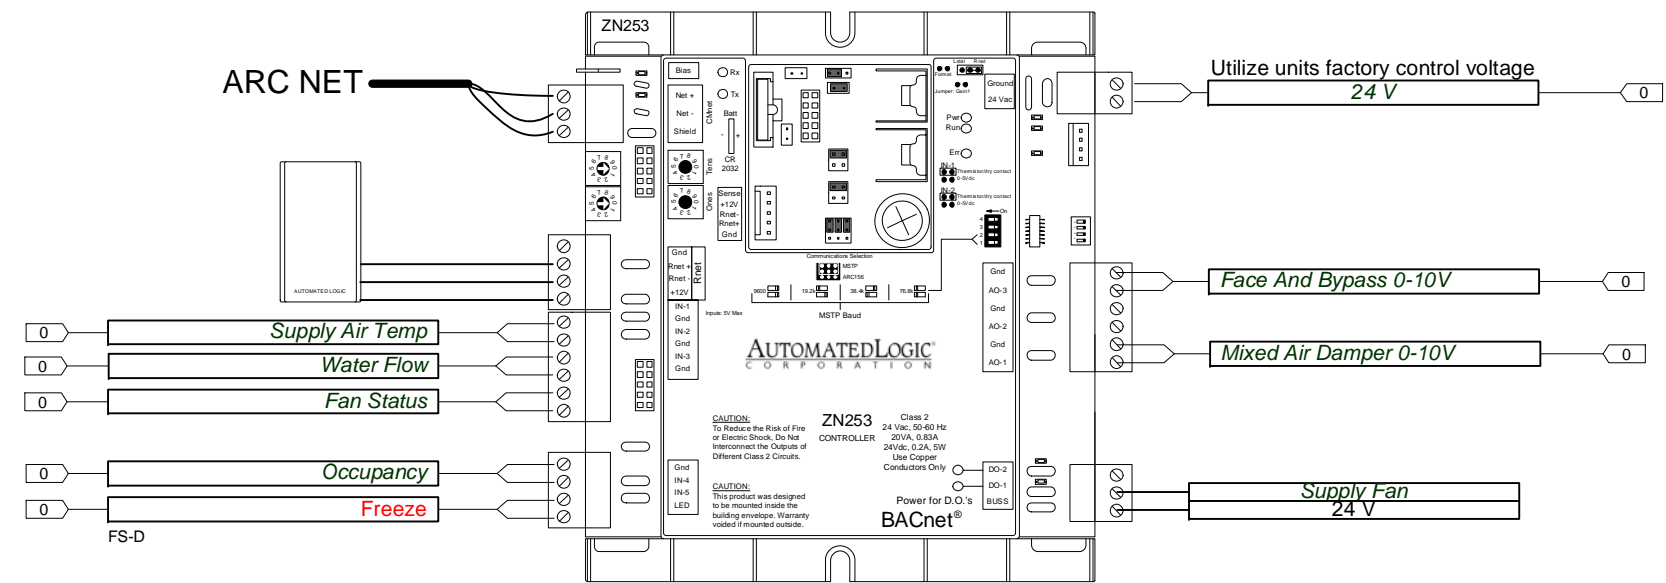

Candor Schools
Candor, New York


AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR

Unit Ventilators E.S.

REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATEDLOGIC CORPORATION			CHECK BY: RSL
			DSCODE: 07112.00


10 of 26

DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
rib	CURRENT SENSOR	FUNCTIONAL DEVICES	RIBXKF	1 ea

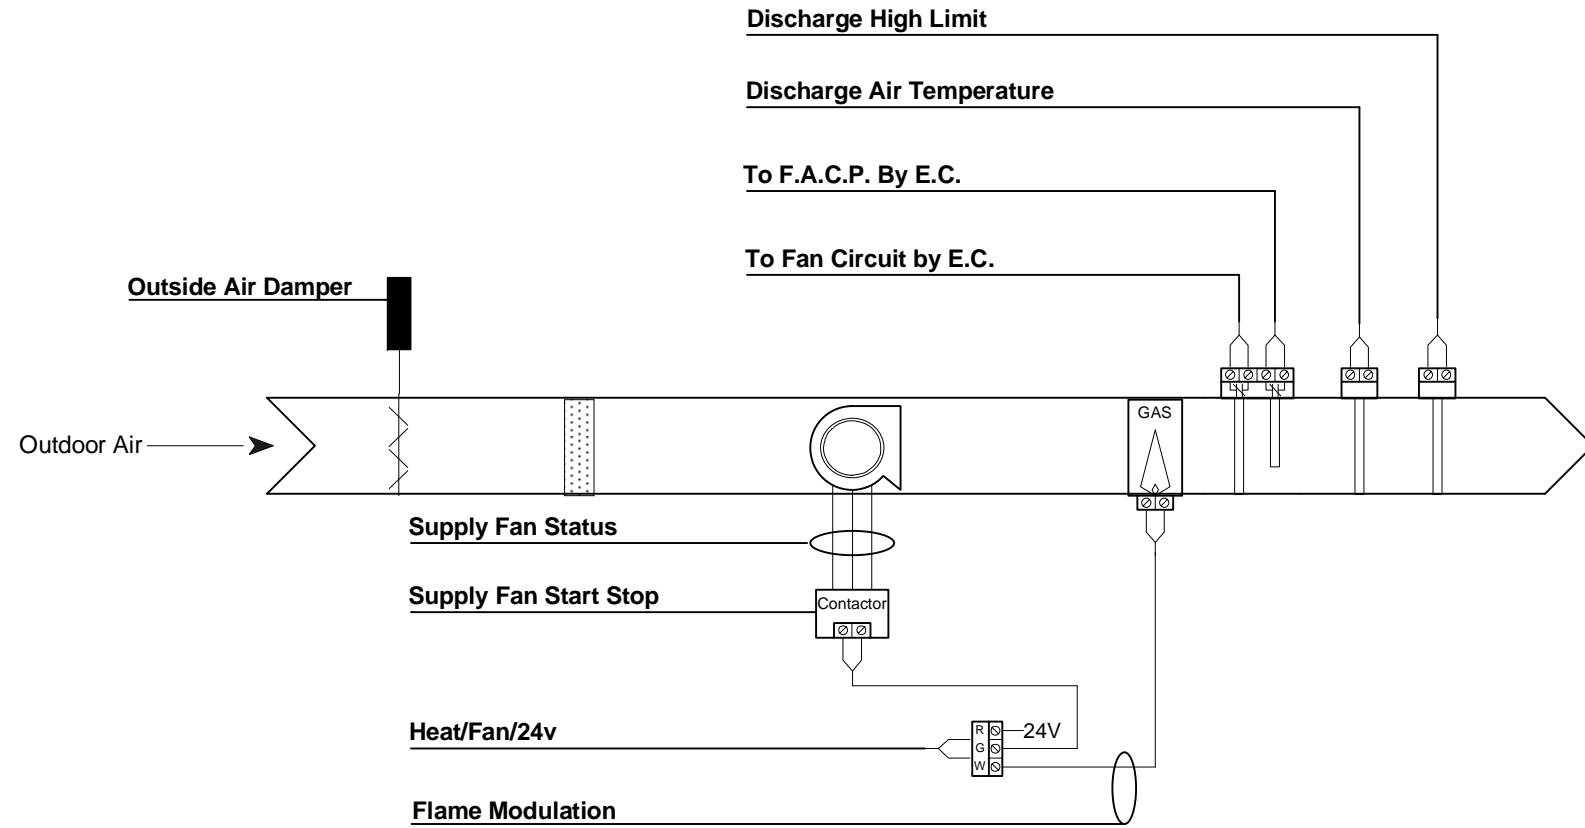

LOGIC UPDATE

System shutdown when generator starts

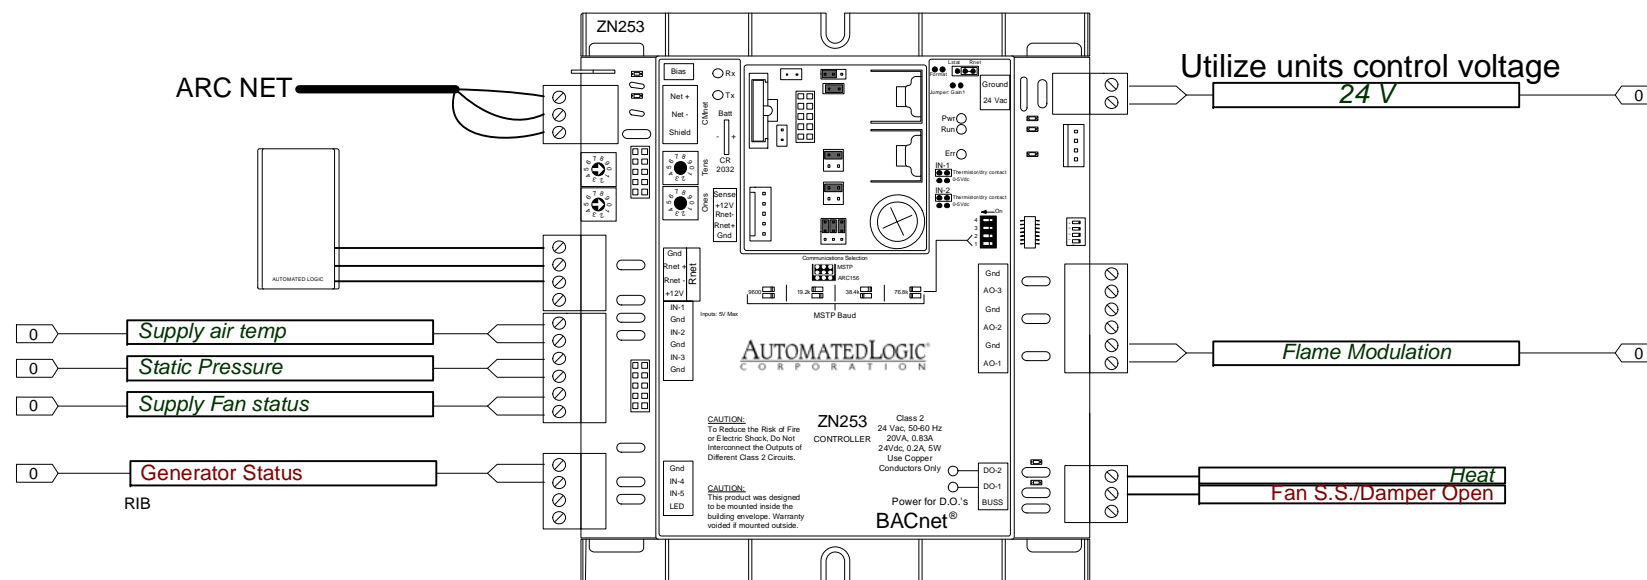

Candor Schools
Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR

RTU 1S Shop H.S.


REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

CHECK BY: RSL
DSCODE: 07112.00

AUTOMATEDLOGIC
CORPORATION



11 of 26

RTU 2 Auditorium H.S.

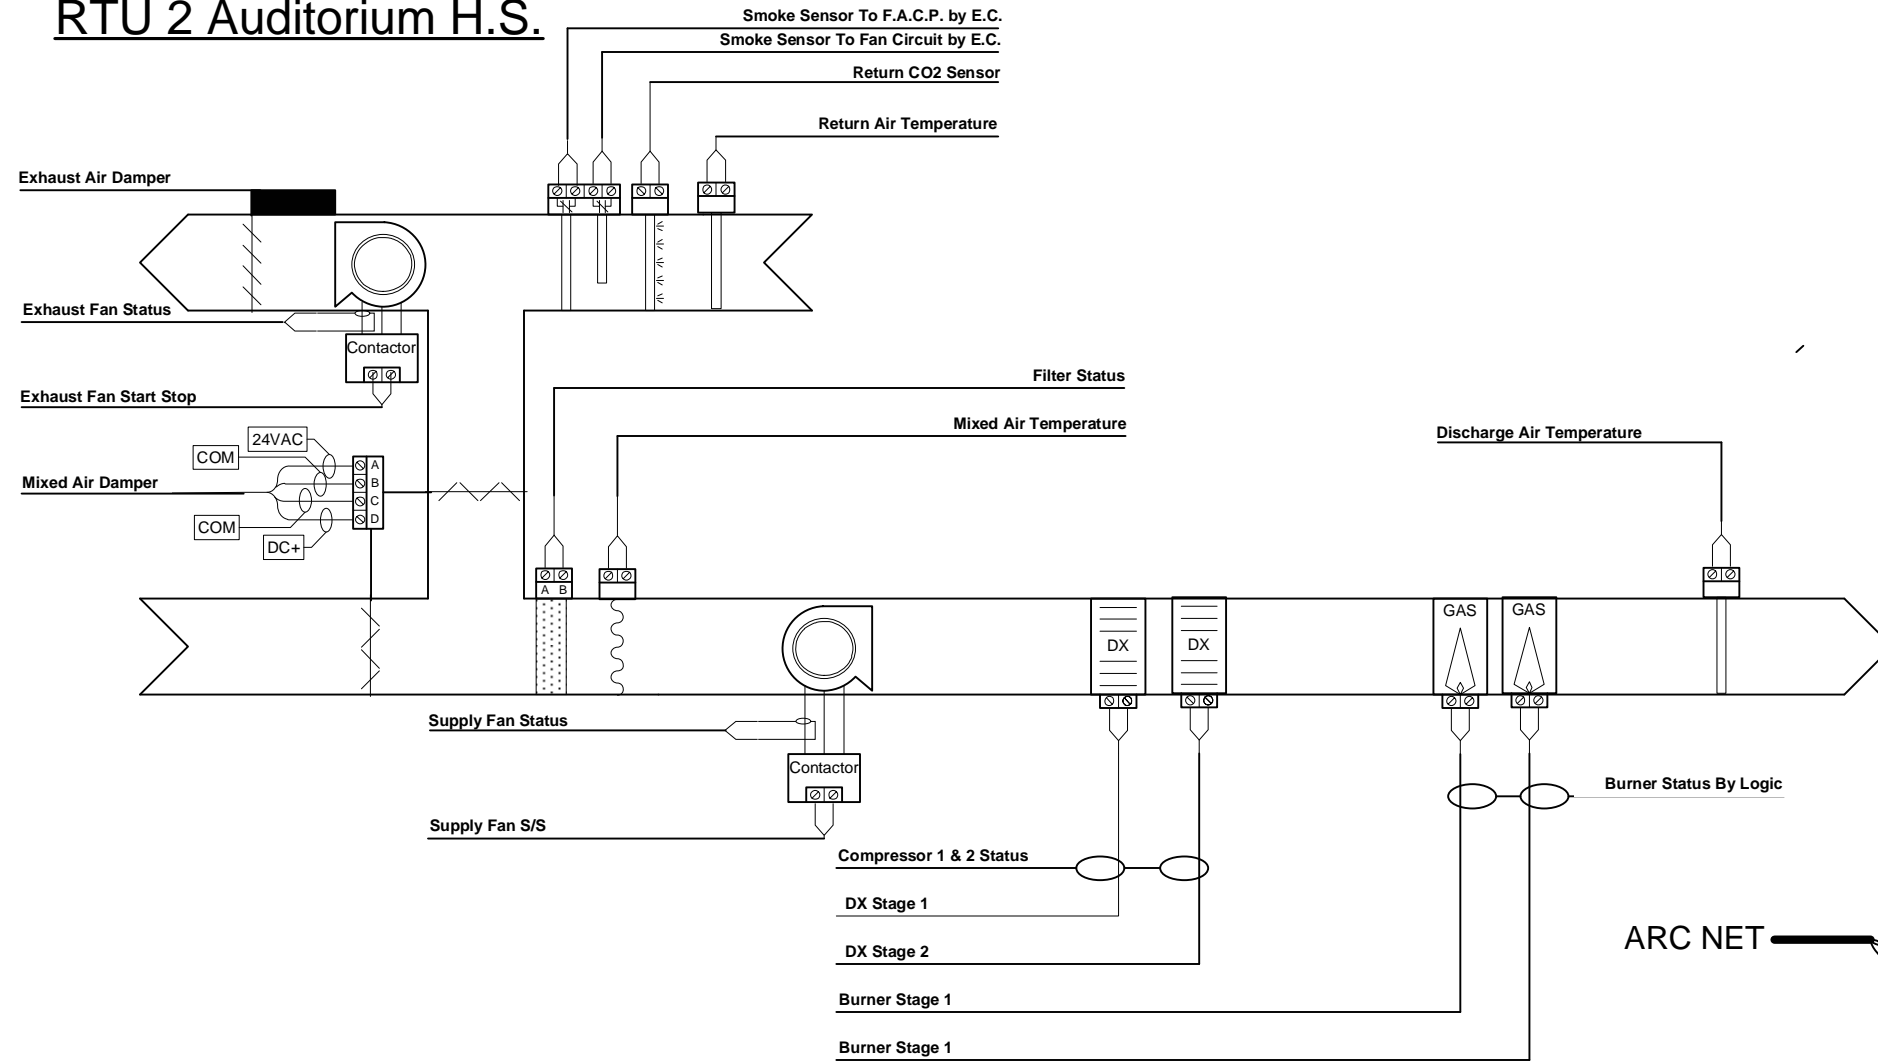

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
A10k-d	DUCT TEMP SENSOR 10K-2	ALPS	A10K-2-D-8	1 ea
BAQ	CO2 SENSOR DUCT MOUNT	BAPI	BA/AQS-D8	2 ea
ZN551	ZN551	AUTOMATED LOGIC	ZN551	1 ea
rib	CURRENT SENSOR	FUNCTIONAL DEVICES	RIBXKF	2 ea

EXISTING CONTROLS
ADDED CONTROLS

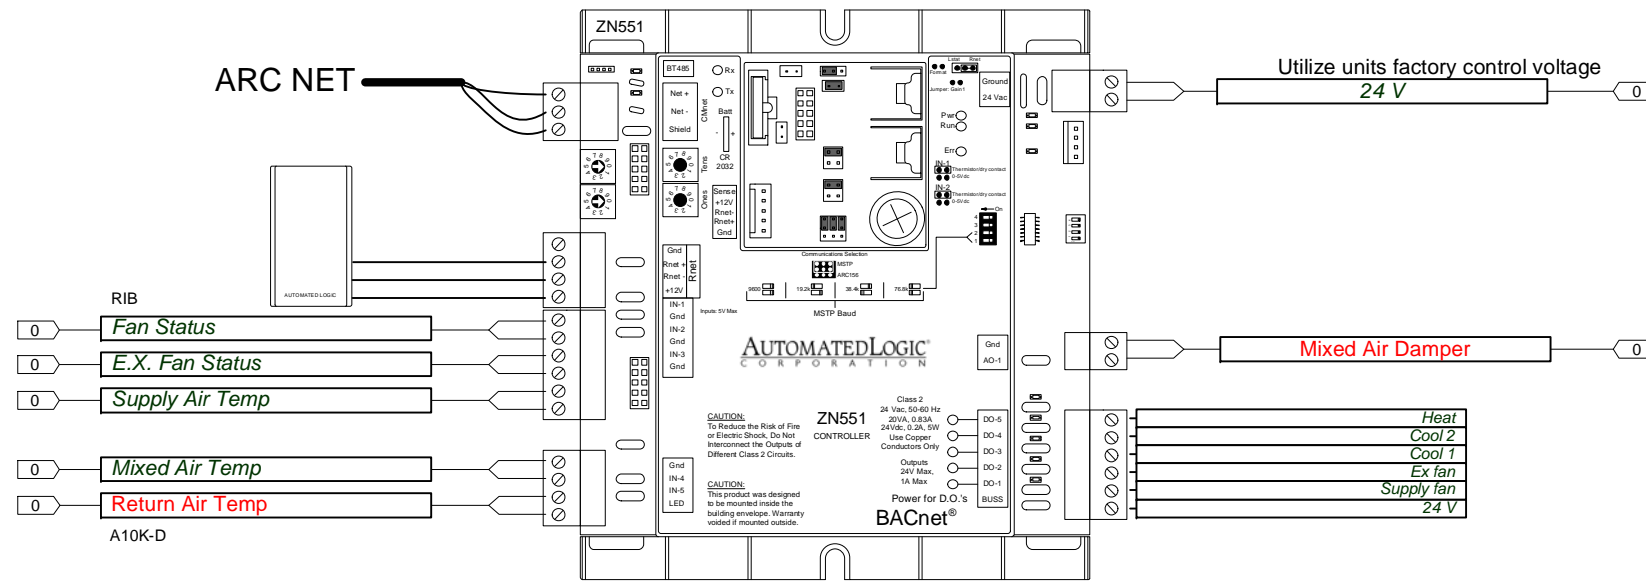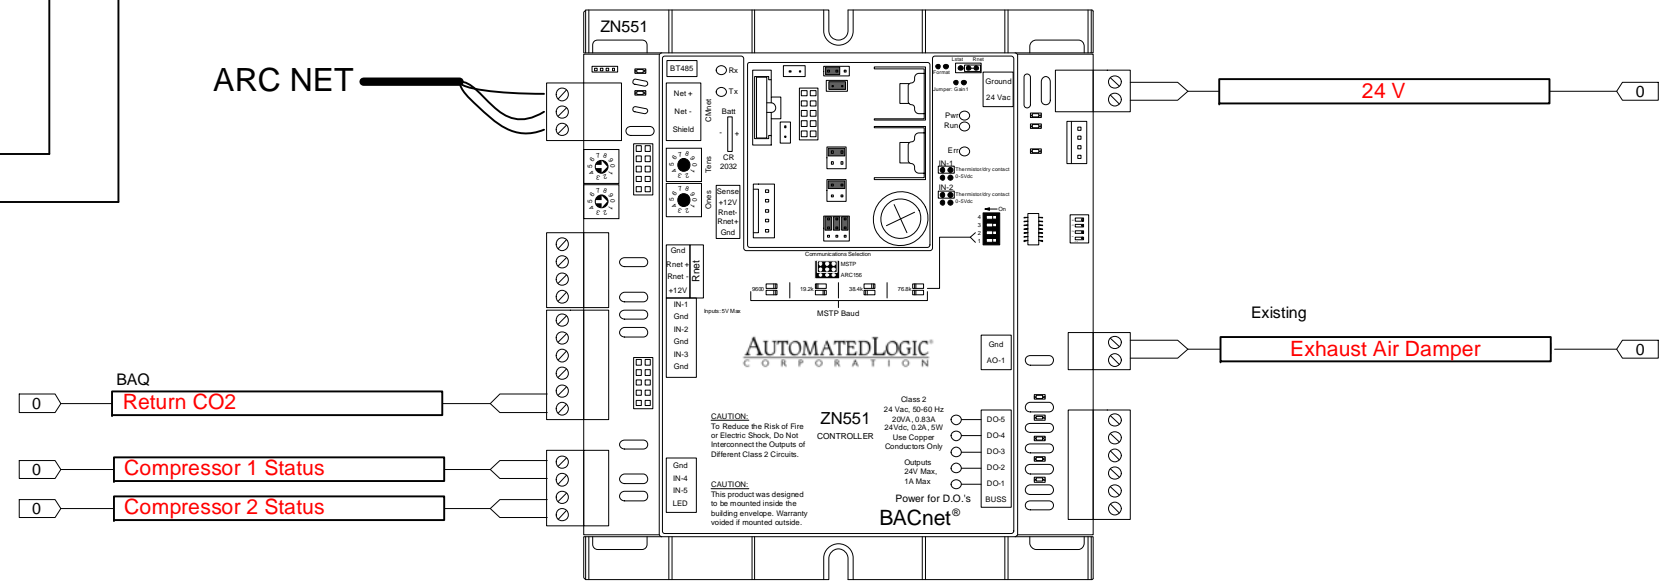

Candor Schools
Candor, New York


AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR

RTU 2 Auditorium H.S.

REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATEDLOGIC CORPORATION			CHECK BY: RSL DSCODE: 07112.00



12 of 26

RTU 7&8 Gym H.S.

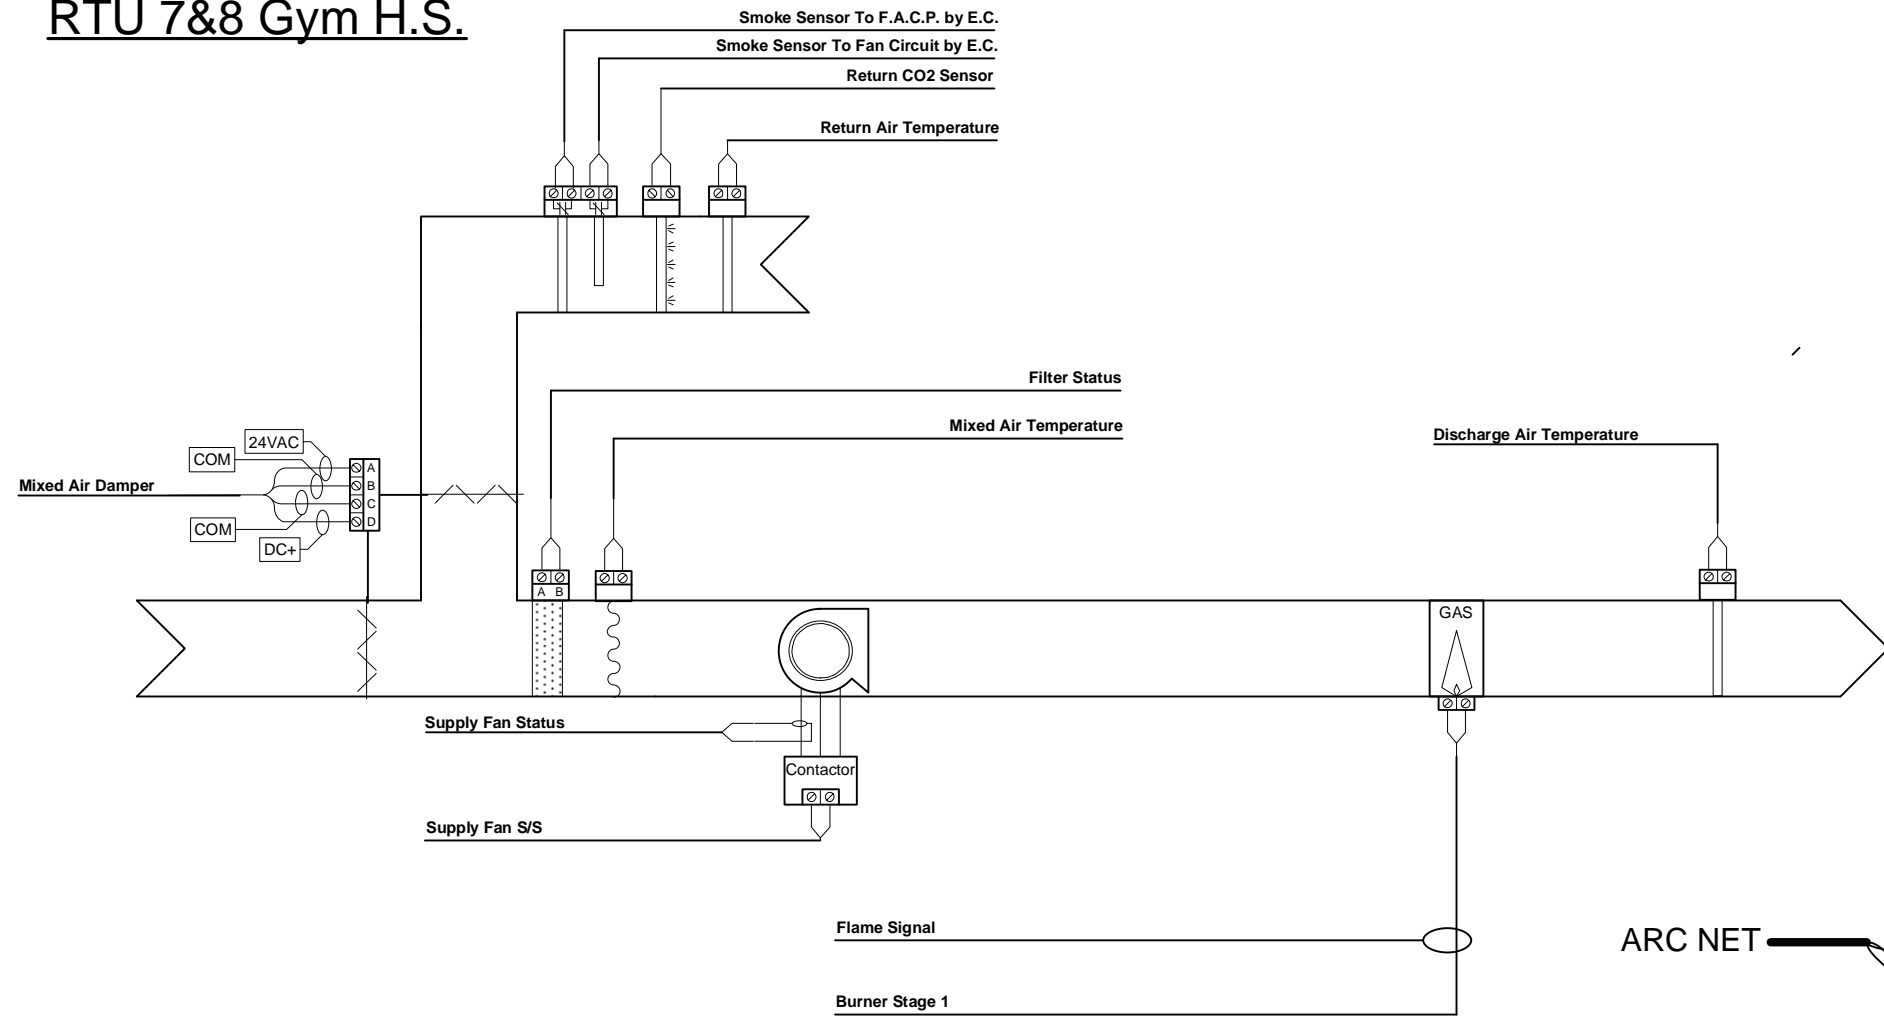

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
A10k-d	DUCT TEMP SENSOR 10K-2	ALPS	A10K-2-D-8	1 ea
BAQ	CO2 SENSOR DUCT MOUNT	BAPI	BA/AQS-D8	2 ea
ZN551	ZN551	AUTOMATED LOGIC	ZN551	2 ea

EXISTING CONTROLS ADDED CONTROLS

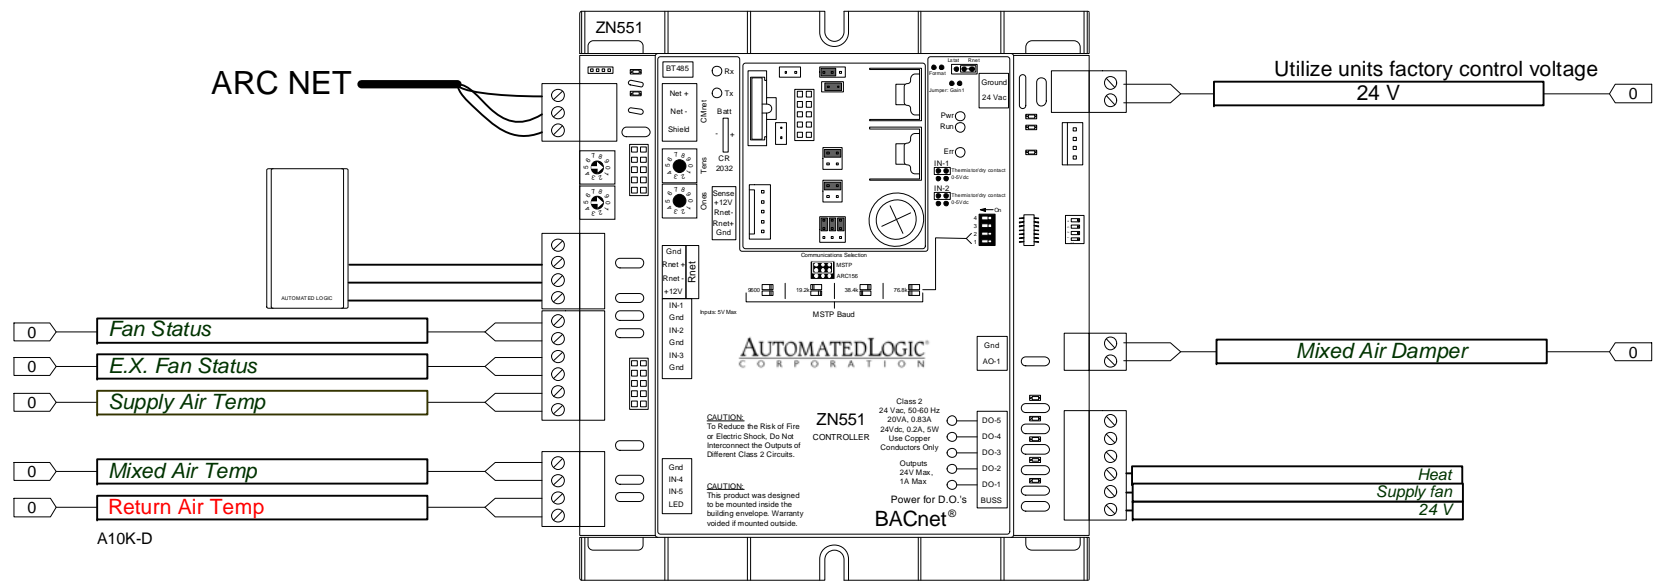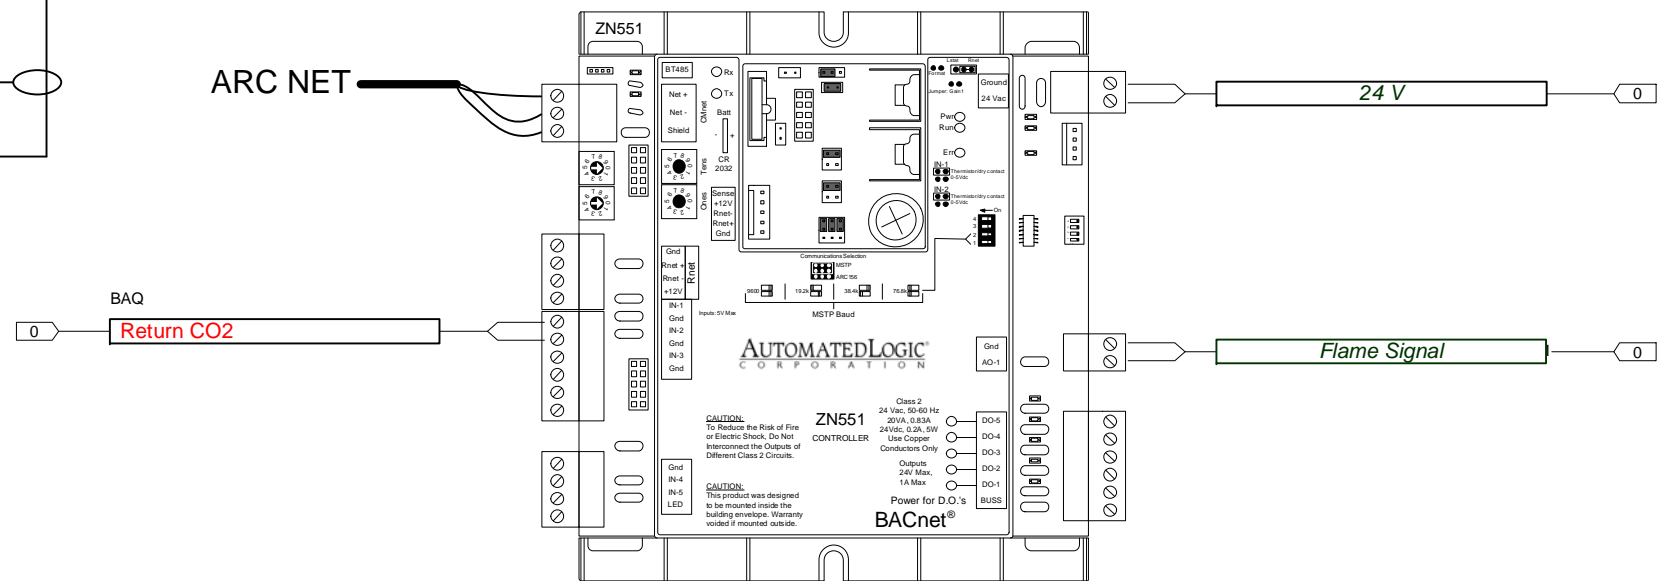

Candor Schools
 Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
 A LINC SERVICE ® CONTRACTOR

RTU 7&8 Gym H.S.

REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

CHECK BY: RSL
 DSCODE: 07112.00


AUTOMATEDLOGIC
 CORPORATION

13 of 26

RTU 8S Weight Room H.S.

Bill of Materials

DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
ZN551	ZN551	AUTOMATED LOGIC	ZN551	0 ea

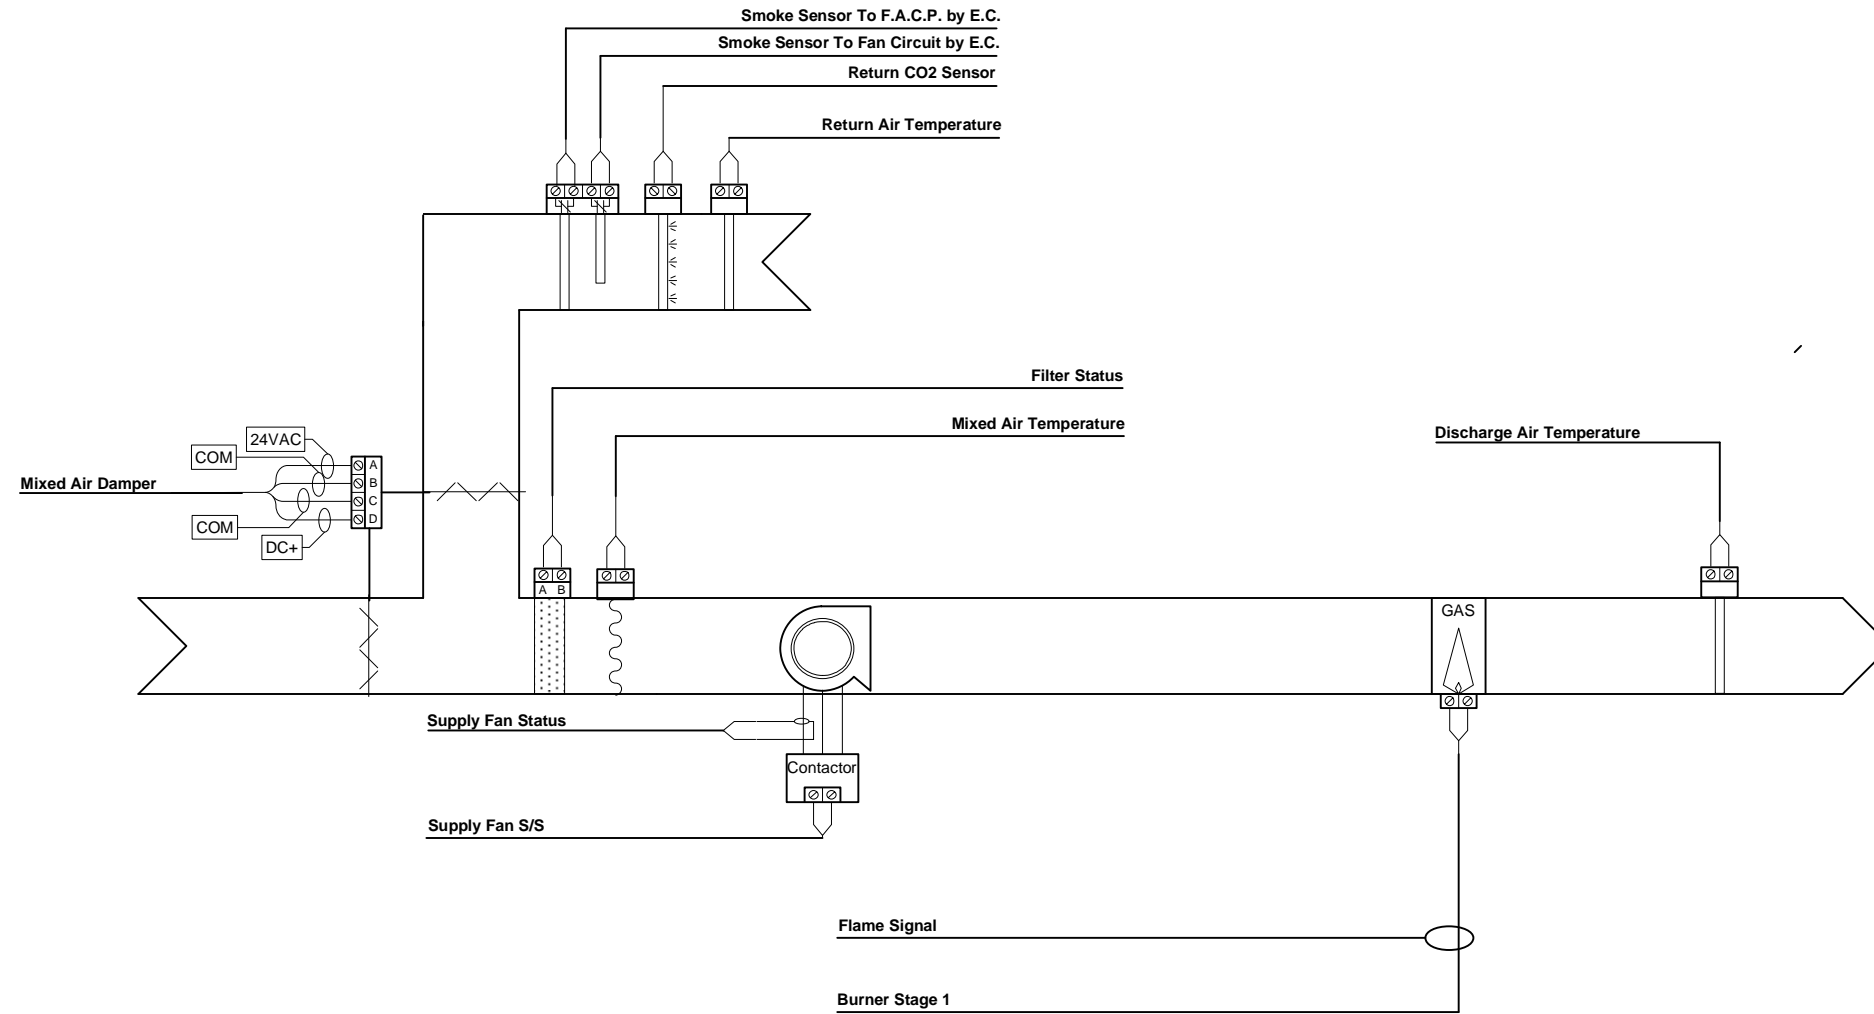


LOGIC UPDATE

Outdoor Air to close on generator start up
 Generator Status will be networked in from RTU 1S controller

EXISTING CONTROLS

ADDED CONTROLS

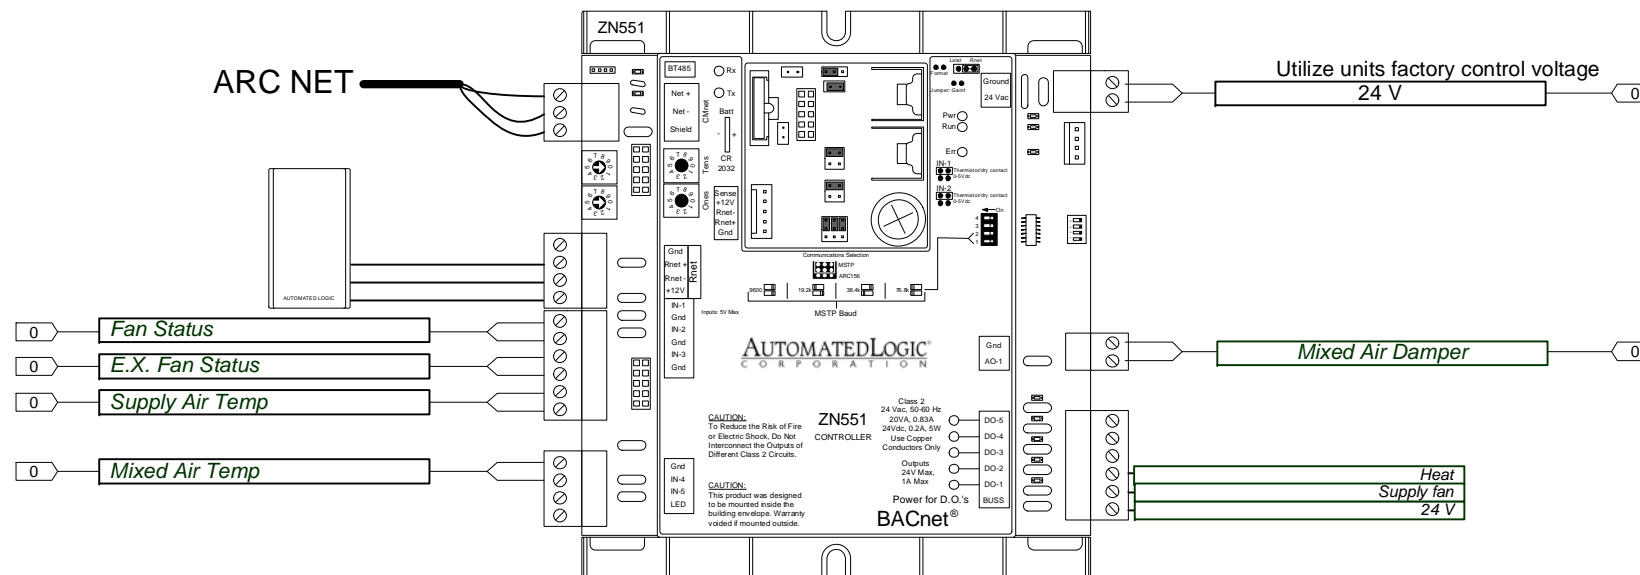

Candor Schools Candor, New York			
AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE ® CONTRACTOR			
RTU 8S Weight Room H.S.			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATED LOGIC CORPORATION			CHECK BY: RSL
			DSCODE: 07112.00
14 of 26			



RTU Cafeteria H.S.

NOTE

This unit is shipped with AAON proprietary factory control, onboard CPU

This on board control processor is BACNET open protocol as specified for the facilities BAS

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
Portal	PORTAL	AUTOMATED LOGIC	PORTAL	1 ea

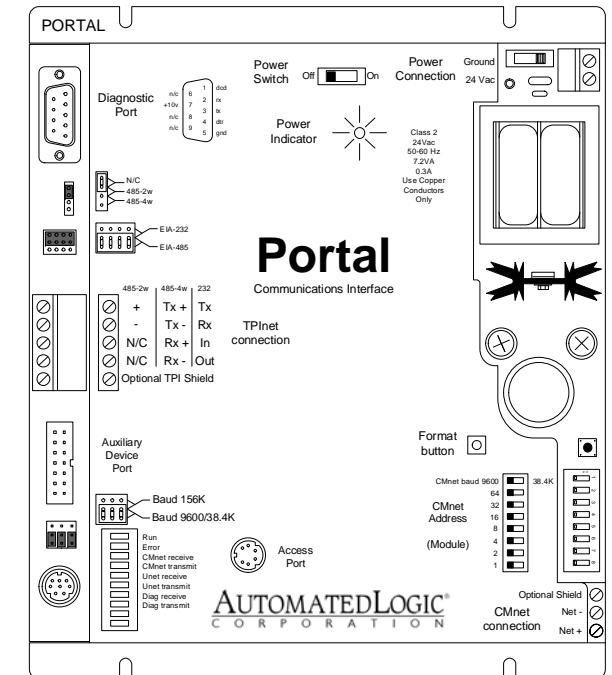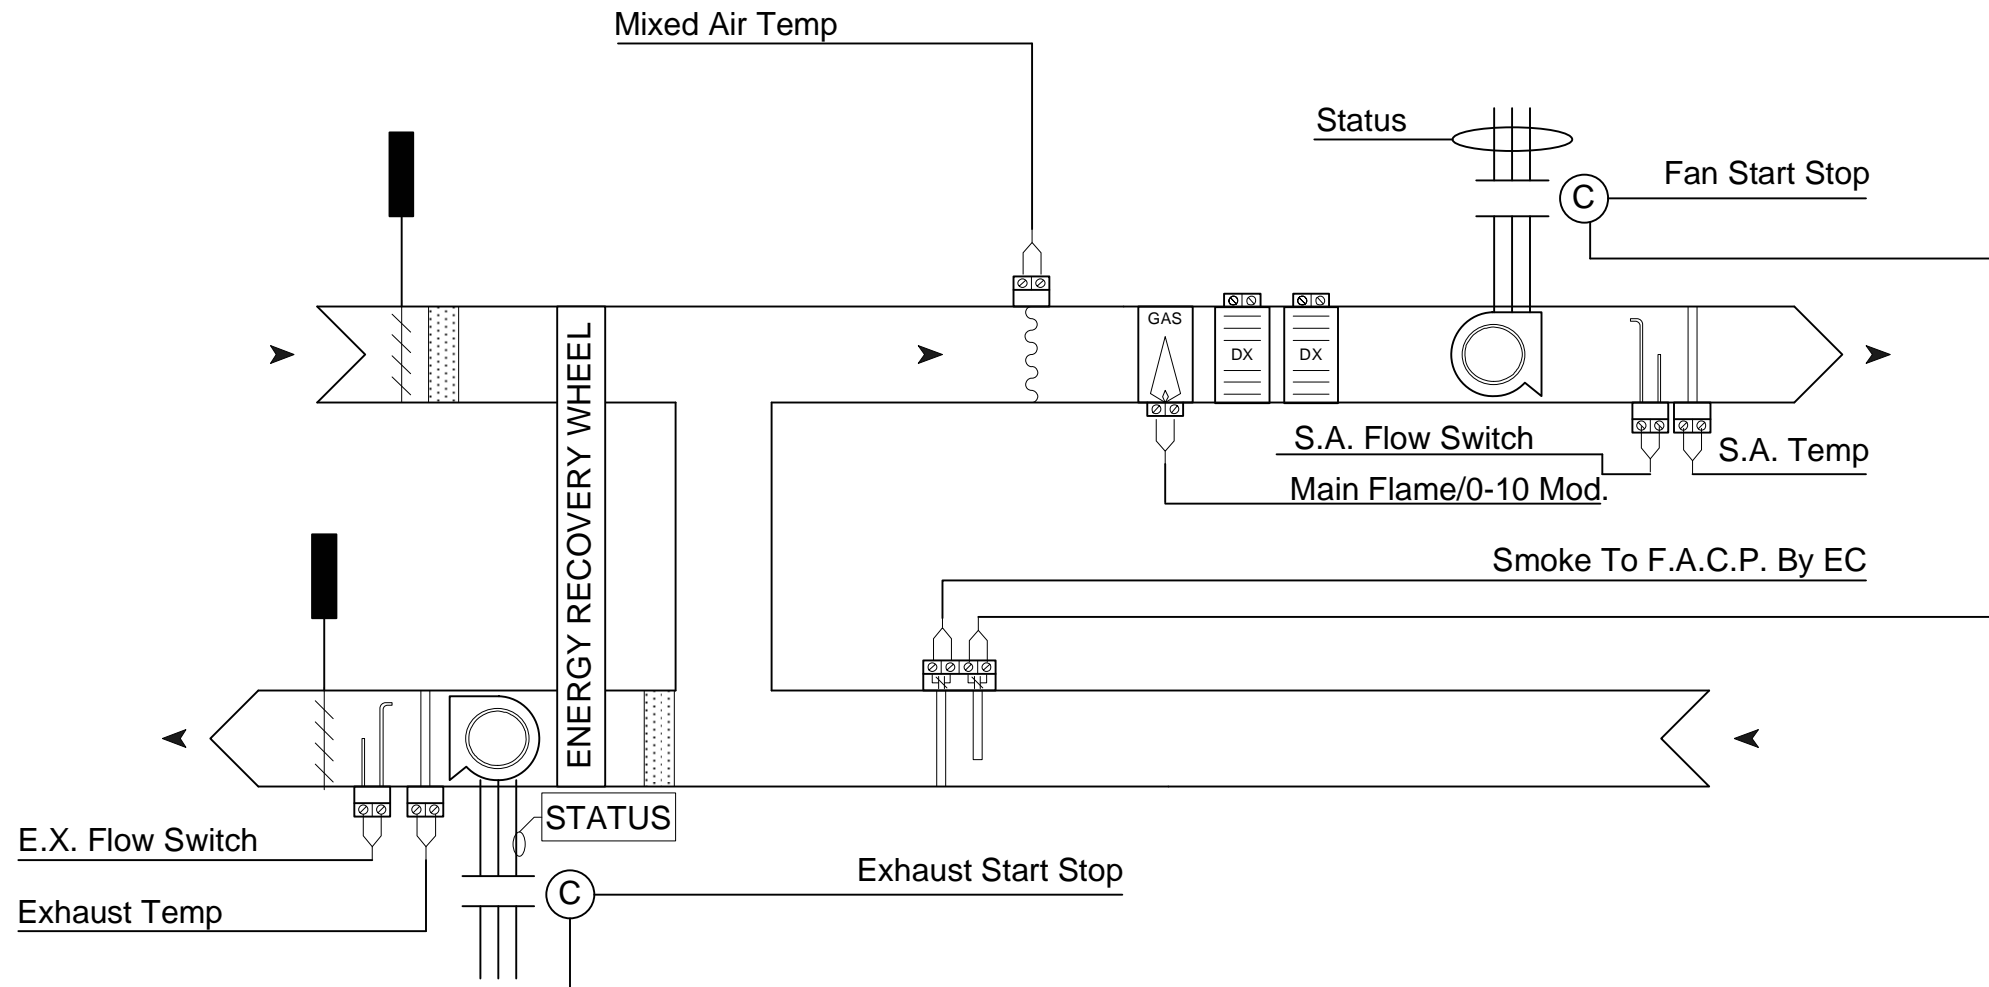

Candor Schools Candor, New York AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE ® CONTRACTOR RTU Cafeteria H.S.			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATED LOGIC CORPORATION			CHECK BY: RSL
			DSCODE: 07112.00
			15 of 26

RTU 1S Cafe E.S.



Bill of Materials

DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
Portal	PORTAL	AUTOMATED LOGIC	PORTAL	1 ea

NOTE

This unit is shipped with AAON proprietary factory control, onboard CPU

This on board control processor is BACNET open protocol as specified for the facilities BAS

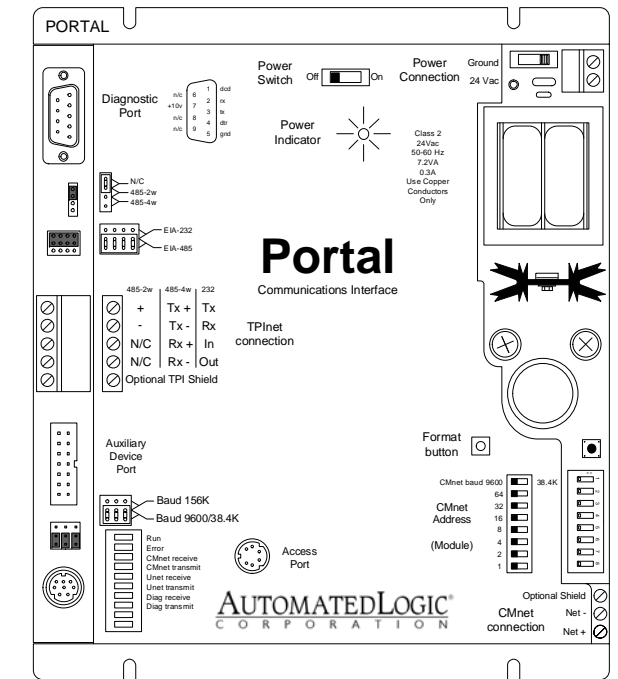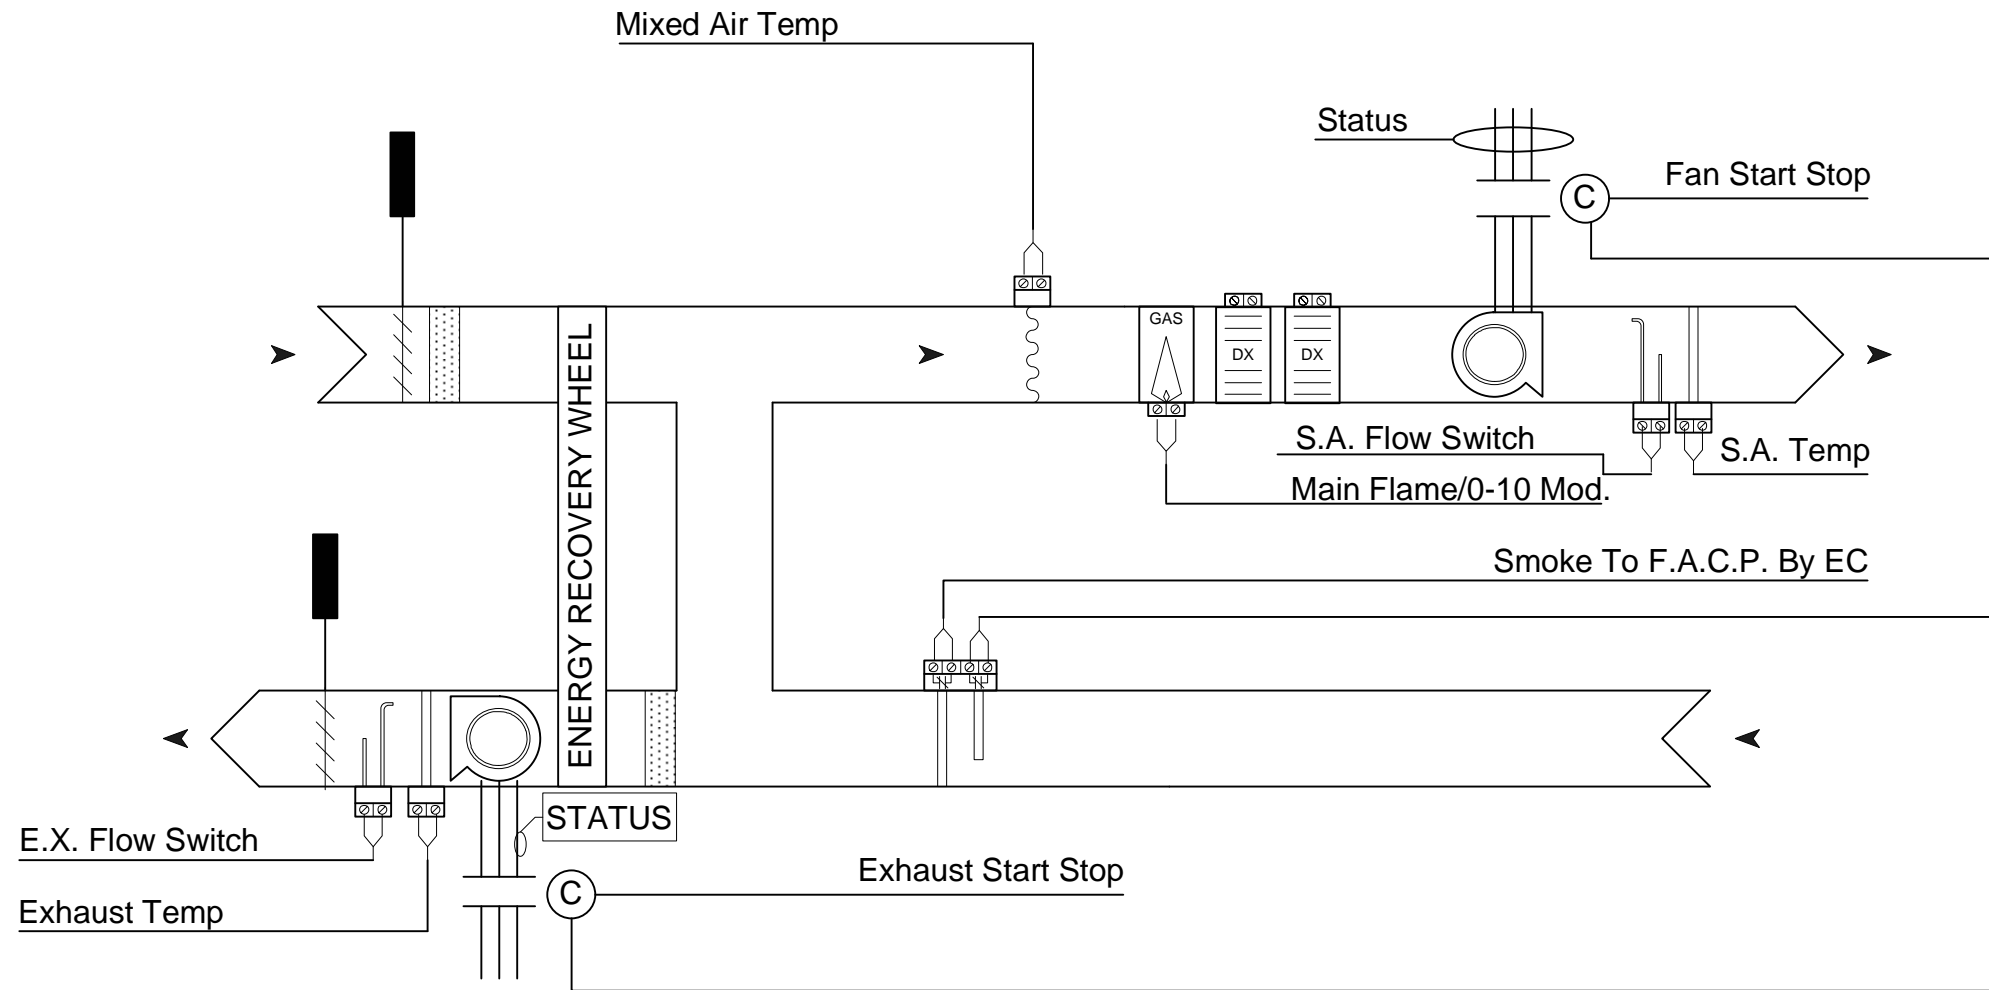

Candor Schools
Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE ® CONTRACTOR


RTU 1S Cafe E.S.

REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

AUTOMATED LOGIC
CORPORATION



CHECK BY: RSL
DSCODE: 07112.00

RTU MP RM E.L.

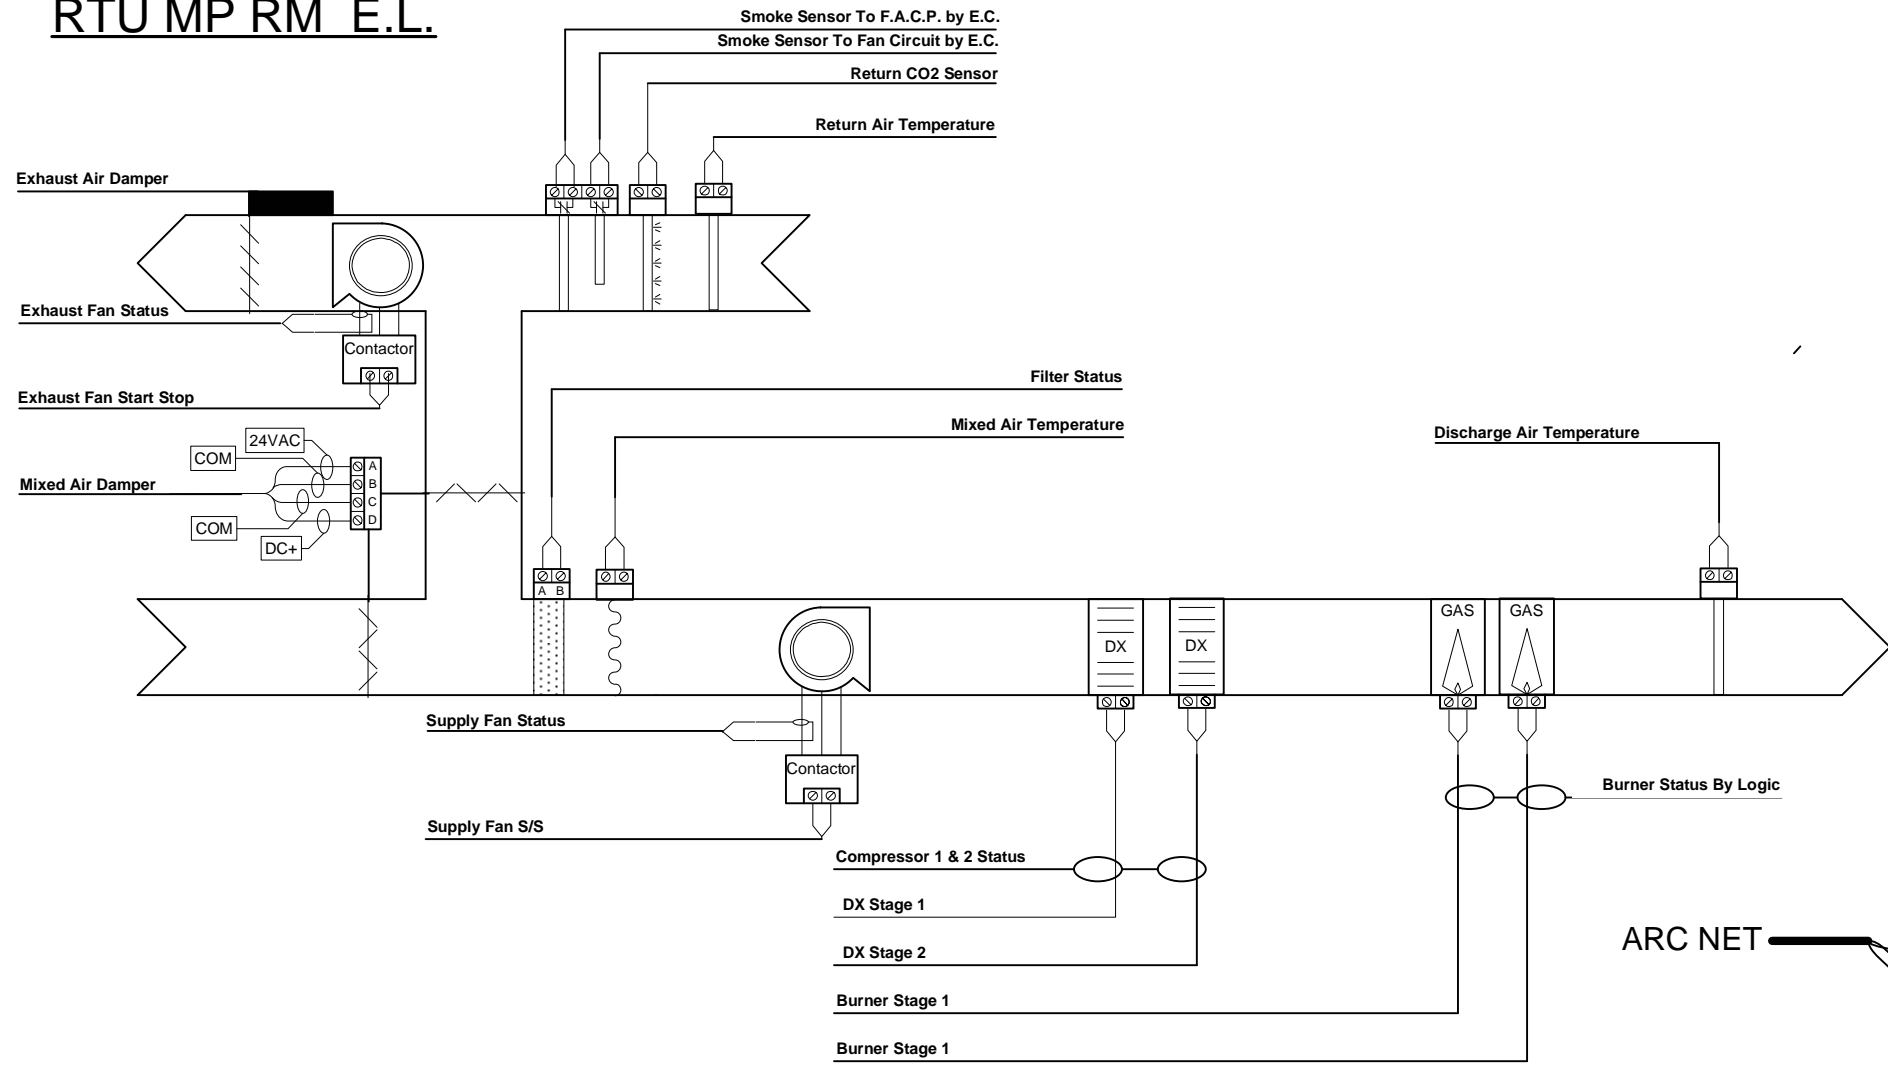

Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
A10k-d	DUCT TEMP SENSOR 10K-2	ALPS	A10K-2-D-8	1 ea
BAQ	CO2 SENSOR DUCT MOUNT	BAPI	BA/AQS-D8	2 ea
ZN551	ZN551	AUTOMATED LOGIC	ZN551	1 ea
rib	CURRENT SENSOR	FUNCTIONAL DEVICES	RIBXKF	2 ea

EXISTING CONTROLS
ADDED CONTROLS

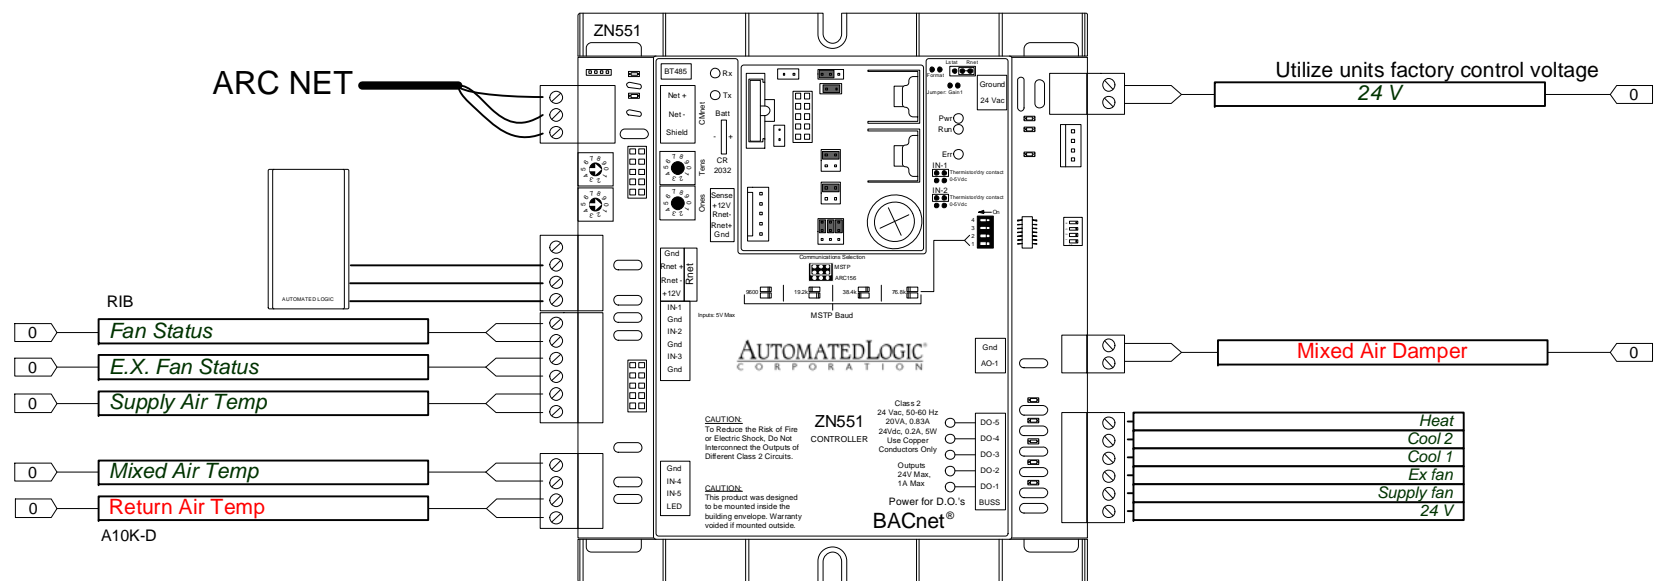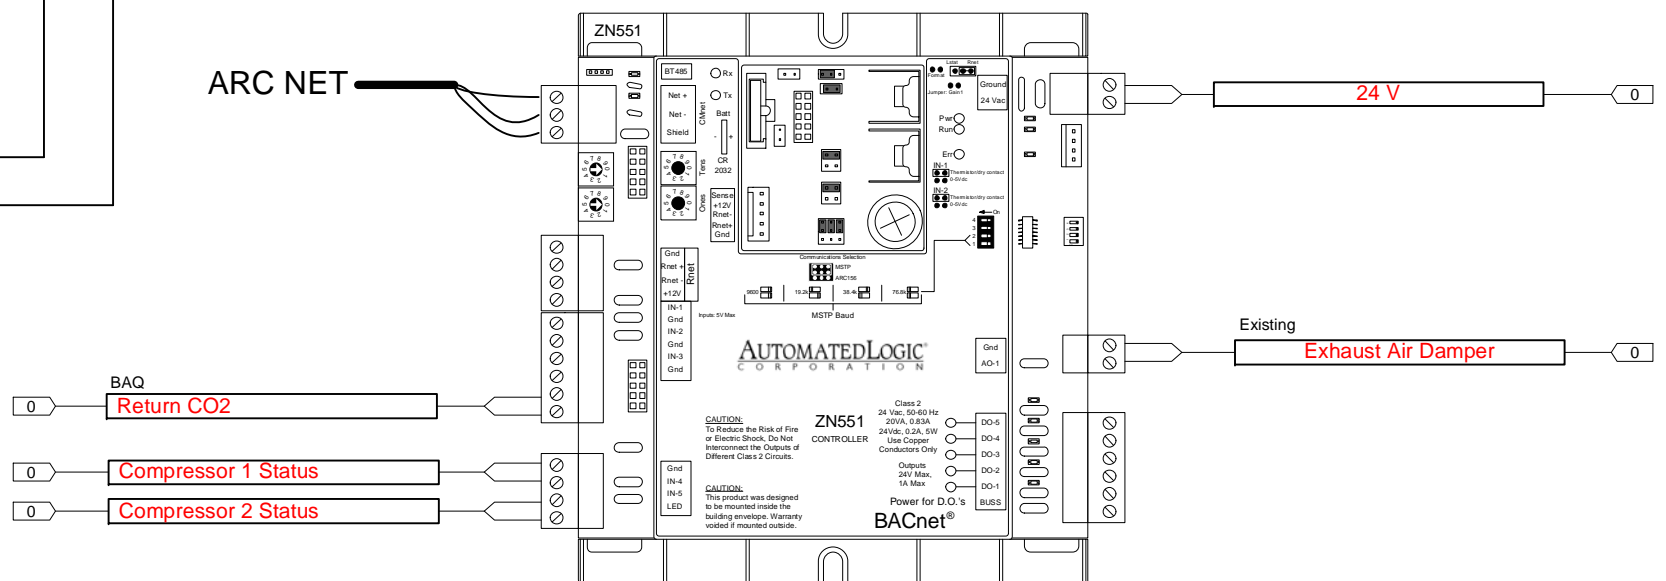

Candor Schools
Candor, New York

AIR TEMP HEATING & AIR CONDITIONING, INC.
A LINC SERVICE @ CONTRACTOR

RTU MP RM E.L.

REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

CHECK BY: RSL
DSCODE: 07112.00


AUTOMATED LOGIC CORPORATION

17 of 26


FC-1 H.S.



Front Entry

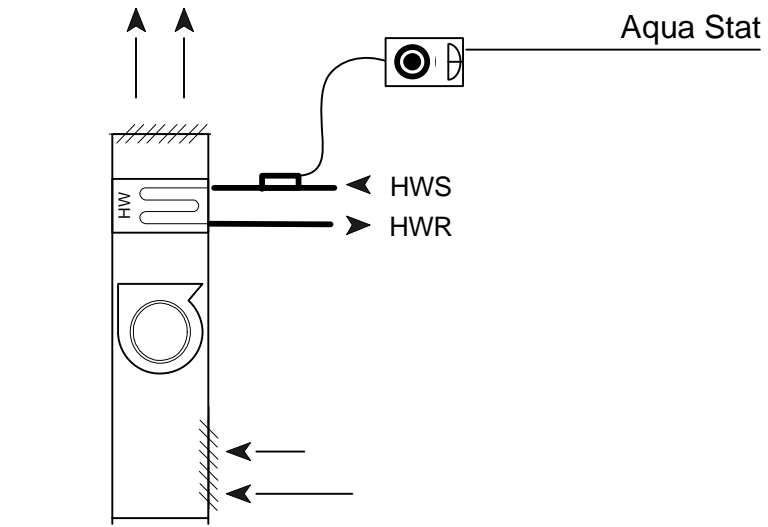Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
A10k-d	DUCT TEMP SENSOR 10K-2	ALPS	A10K-2-D-8	1 ea
REL-F	RIB PILOT RELAY SPDT 10AMP	KELE & ASSOC.	RIBU1C	1 ea
TR50	50 VA TRANSFORMER	FUNCTIONAL DEVICES	TR50VA	1 ea
ZN220	ZN220	AUTOMATED LOGIC	ZN220	1 ea
rib	CURRENT SENSOR	FUNCTIONAL DEVICES	RIBXKF	1 ea
rsp	RSPL	ALC	RSPL	1 ea

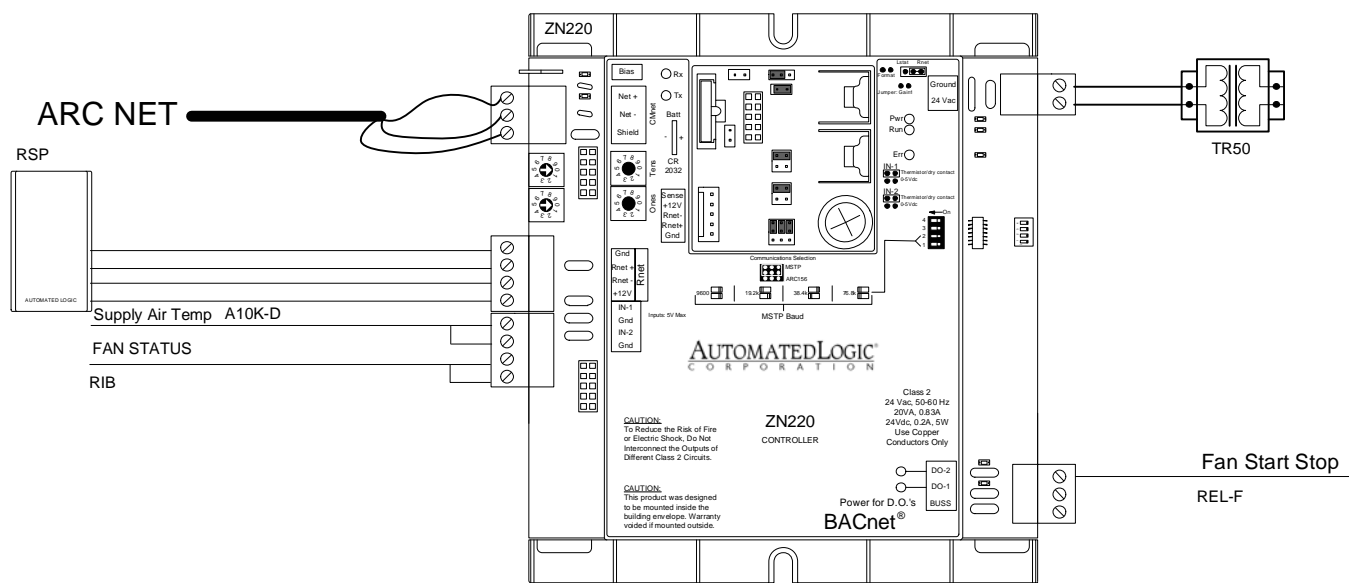


CABINET HEATER



Candor Schools Candor, New York  A LINC SERVICE ® CONTRACTOR FC-1 H.S.			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			18 of 26

VAV H.S.

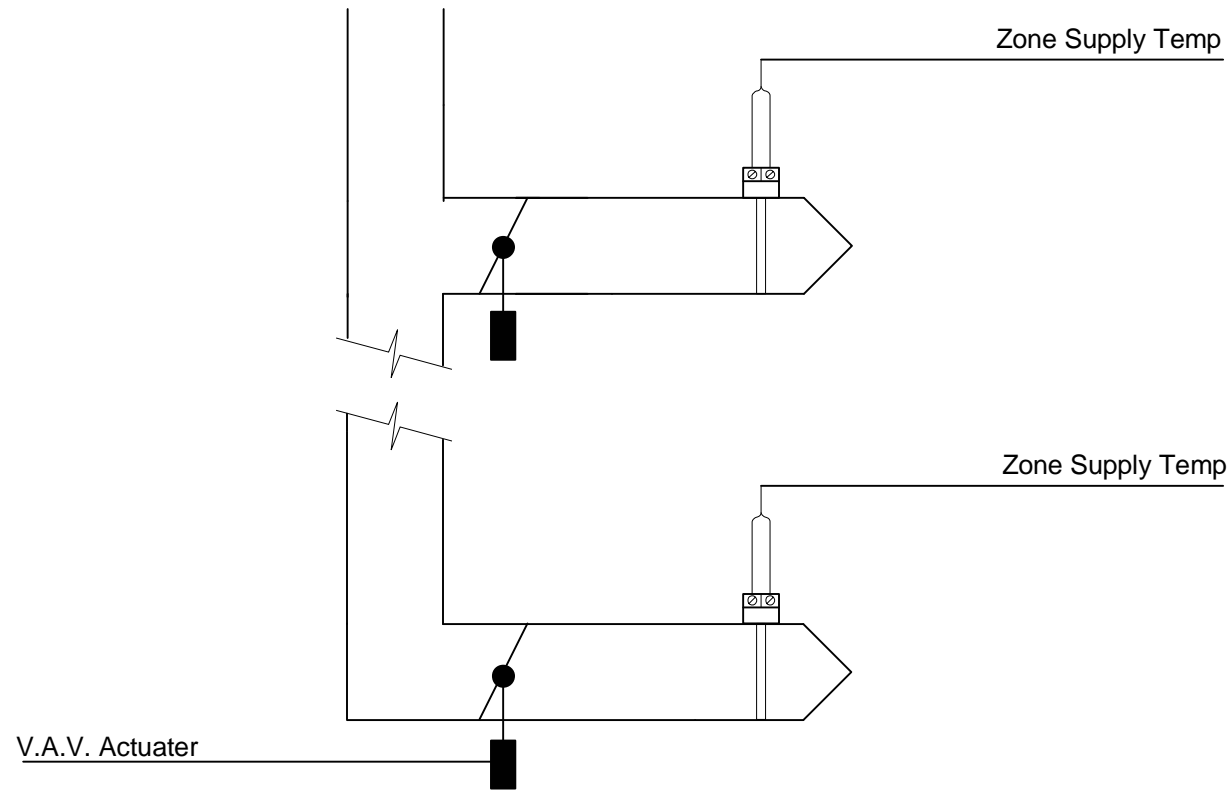


Bill of Materials				
DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
DA-CE	SR 0-10VDC 35 IN-LB 24 V	BELIMO	LF24-SR ALC	5 ea
DTS-D	DUCT 10K THERMISTOR PROBE 8 IN.	BAPI	ALC/10K-2-D-8	5 ea
U551	U551	AUTOMATED LOGIC	U551	5 ea
ZN551	ZN551	AUTOMATED LOGIC	ZN551	5 ea



NOTES

1. Space Sensor is shared with U.V. Sensor

SERVING

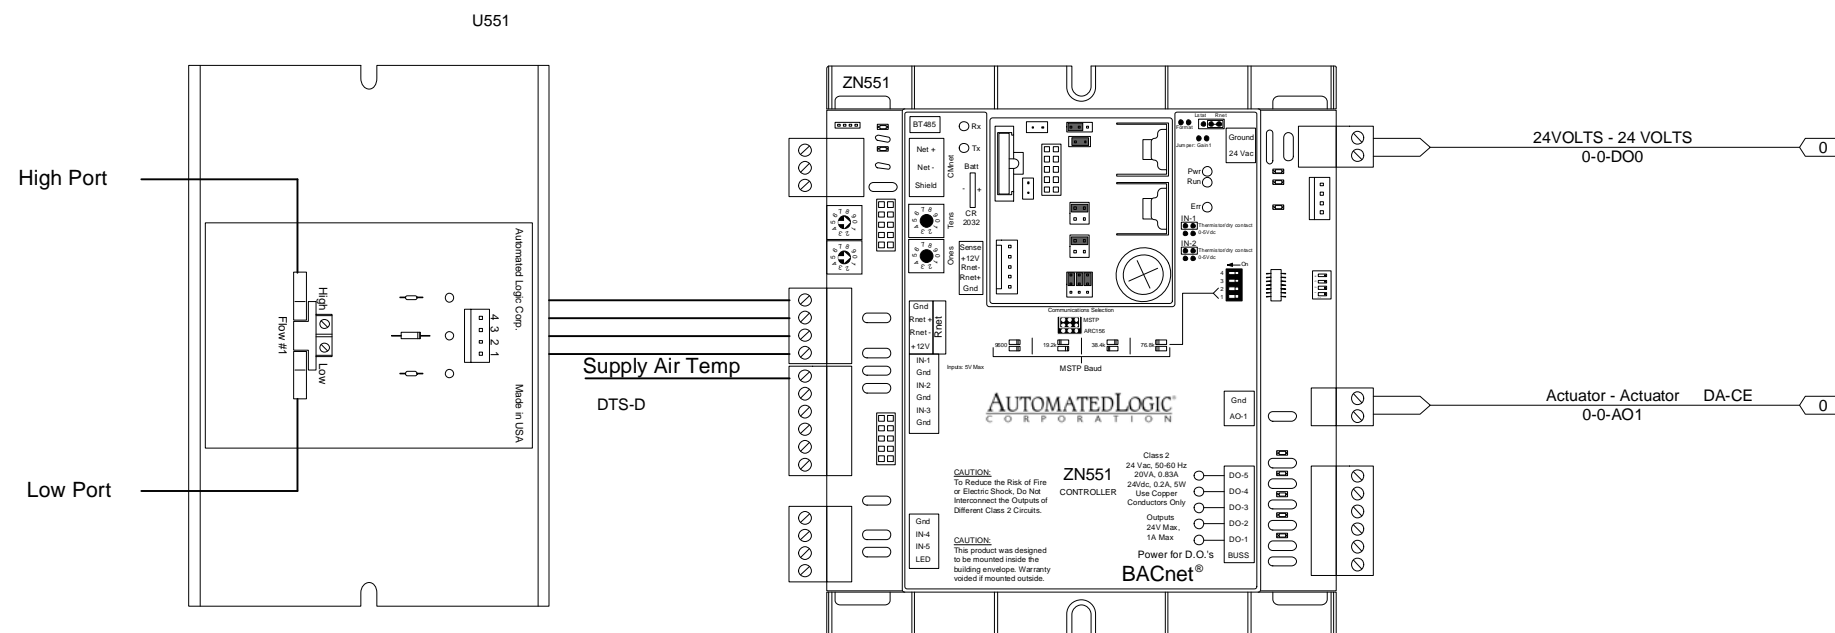- English S 209
- English S 207
- Teachers Work Room S 205
- Faculty S 204





Candor Schools Candor, New York  A LINC SERVICE ® CONTRACTOR VAV H.S.			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			19 of 26

Domestic Boiler Fresh Air

Bill of Materials

DID	DESCRIPTION	MANUFACTURER	PART NUMBER	QTY
ZN220	ZN220	AUTOMATED LOGIC	ZN220	1 ea
rsp	RSPL	ALC	RSPL	1 ea

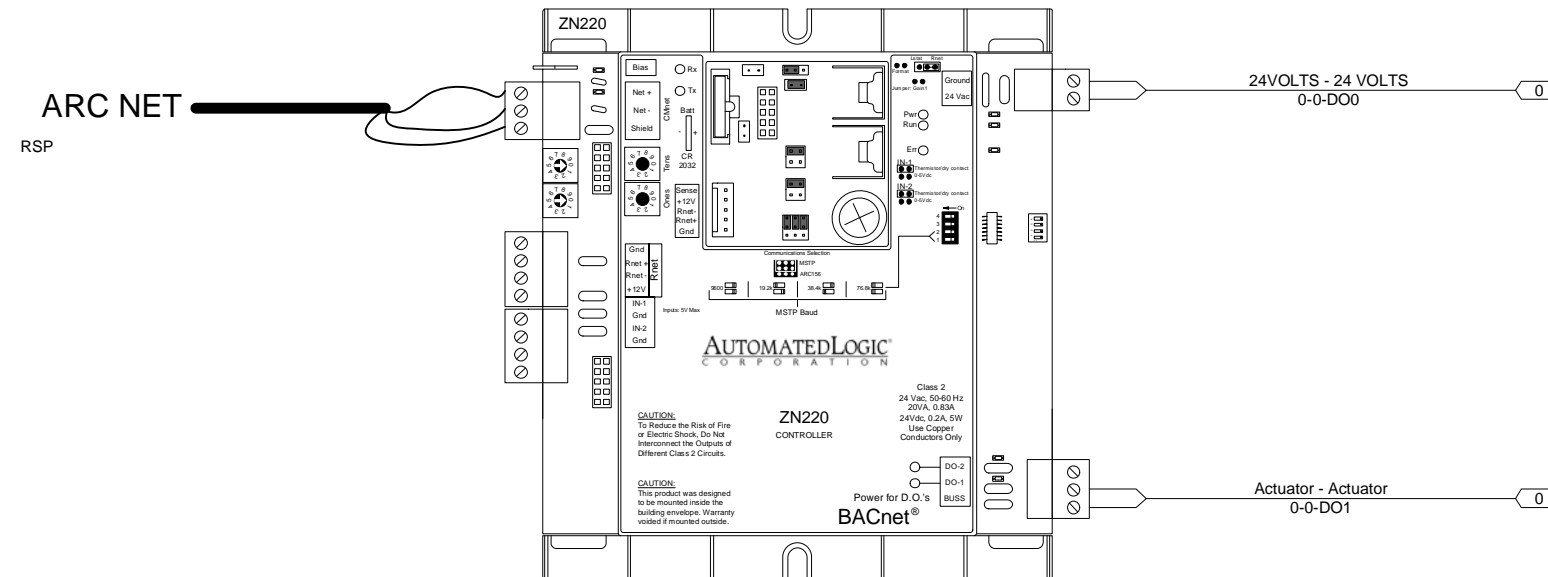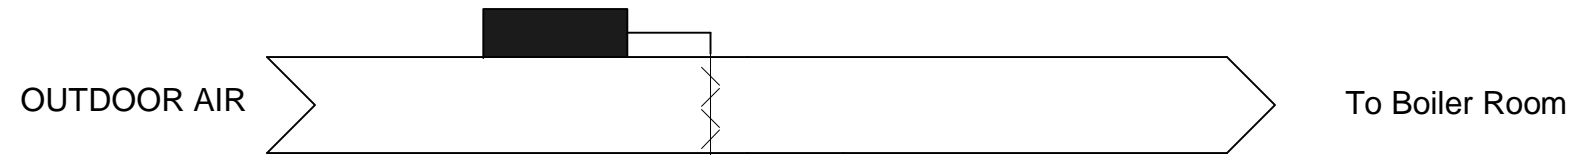

Candor Schools
Candor, New York

 **AIR TEMP HEATING & AIR CONDITIONING, INC.**
A LINC SERVICE ® CONTRACTOR


Domestic Boiler Fresh Air



REV: 1	Submittal	9/29/2008	JOB NO: P7793
--------	-----------	-----------	---------------

AUTOMATED LOGIC
CORPORATION


CHECK BY: RSL
DSCODE: 07112.00

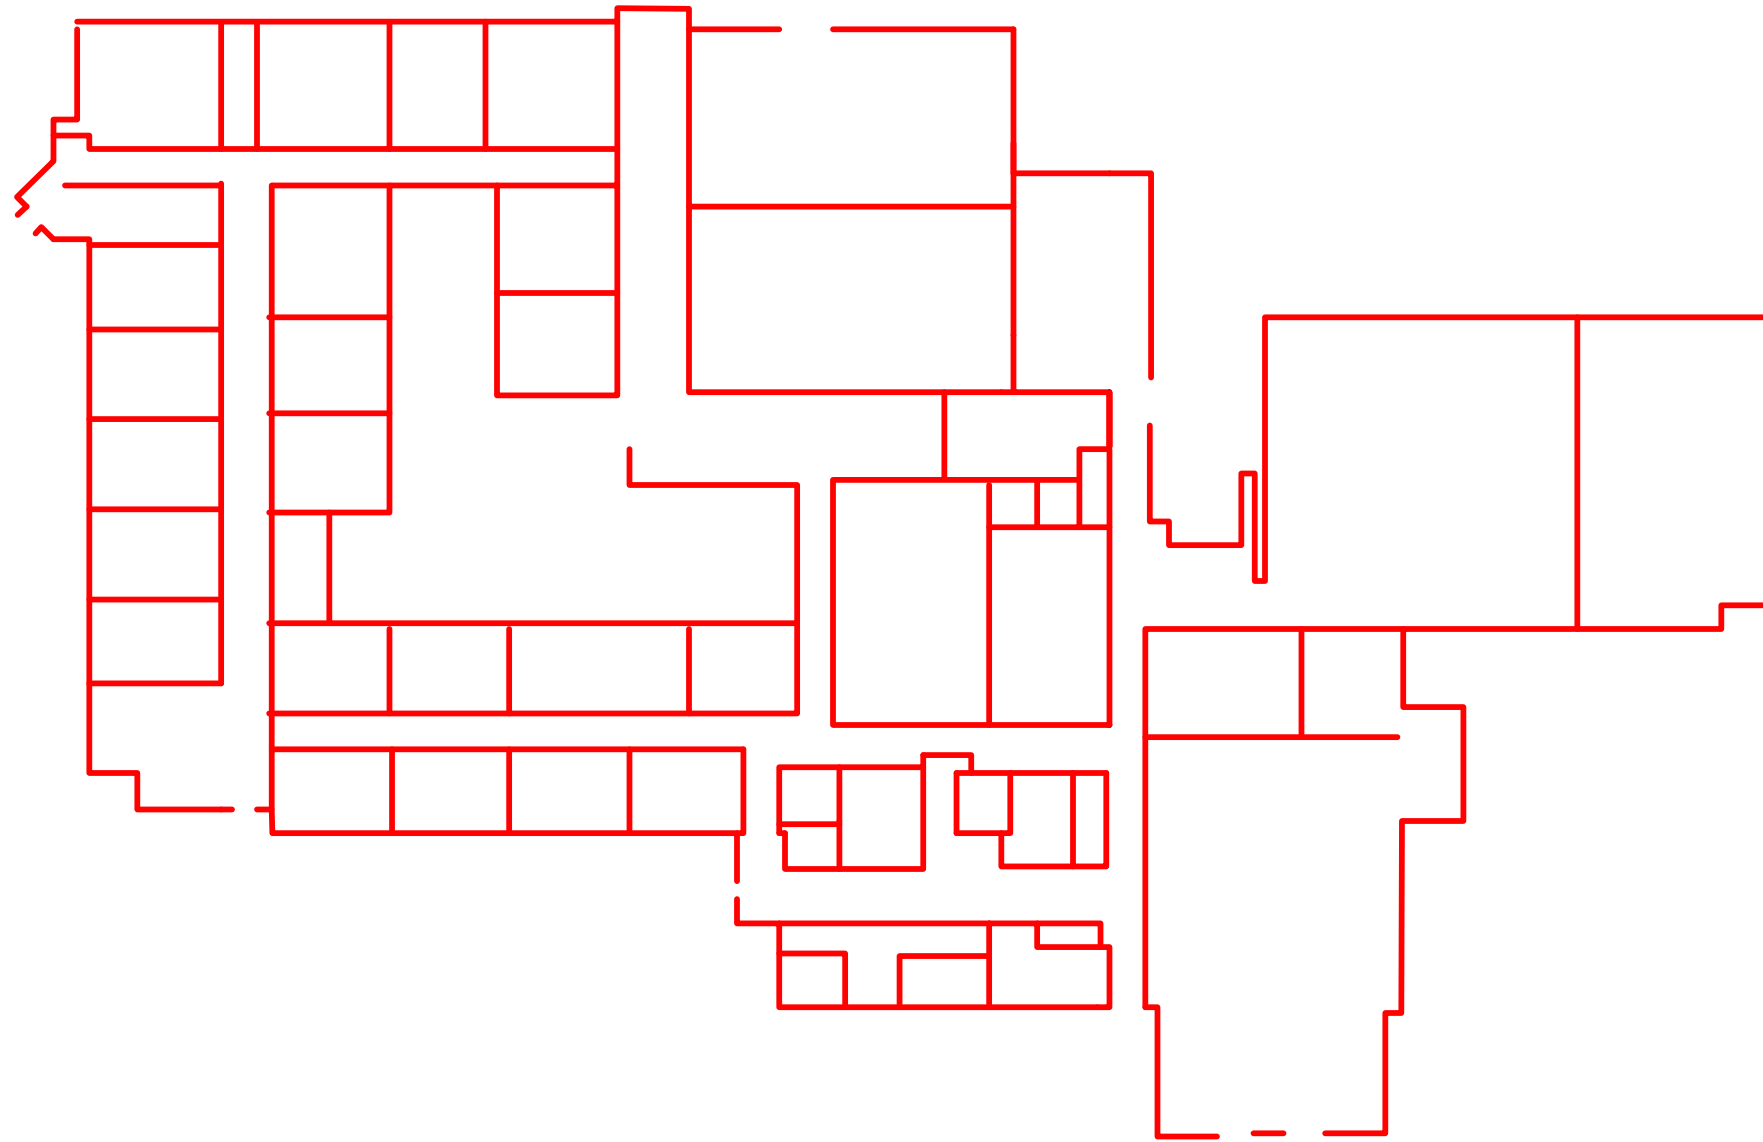

FIRST FLOOR




Candor Schools Candor, New York			
 AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE © CONTRACTOR			
Page-23			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			23 of 26

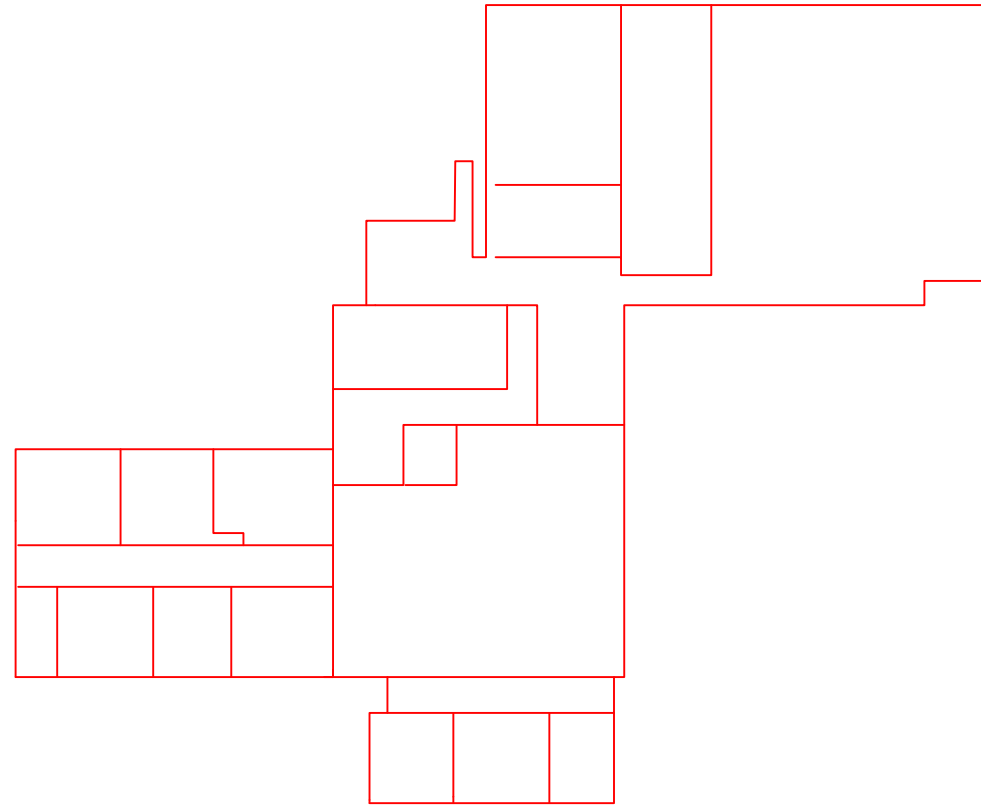BASEMENT




Candor Schools Candor, New York			
 AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE © CONTRACTOR			
Page-24			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			24 of 26

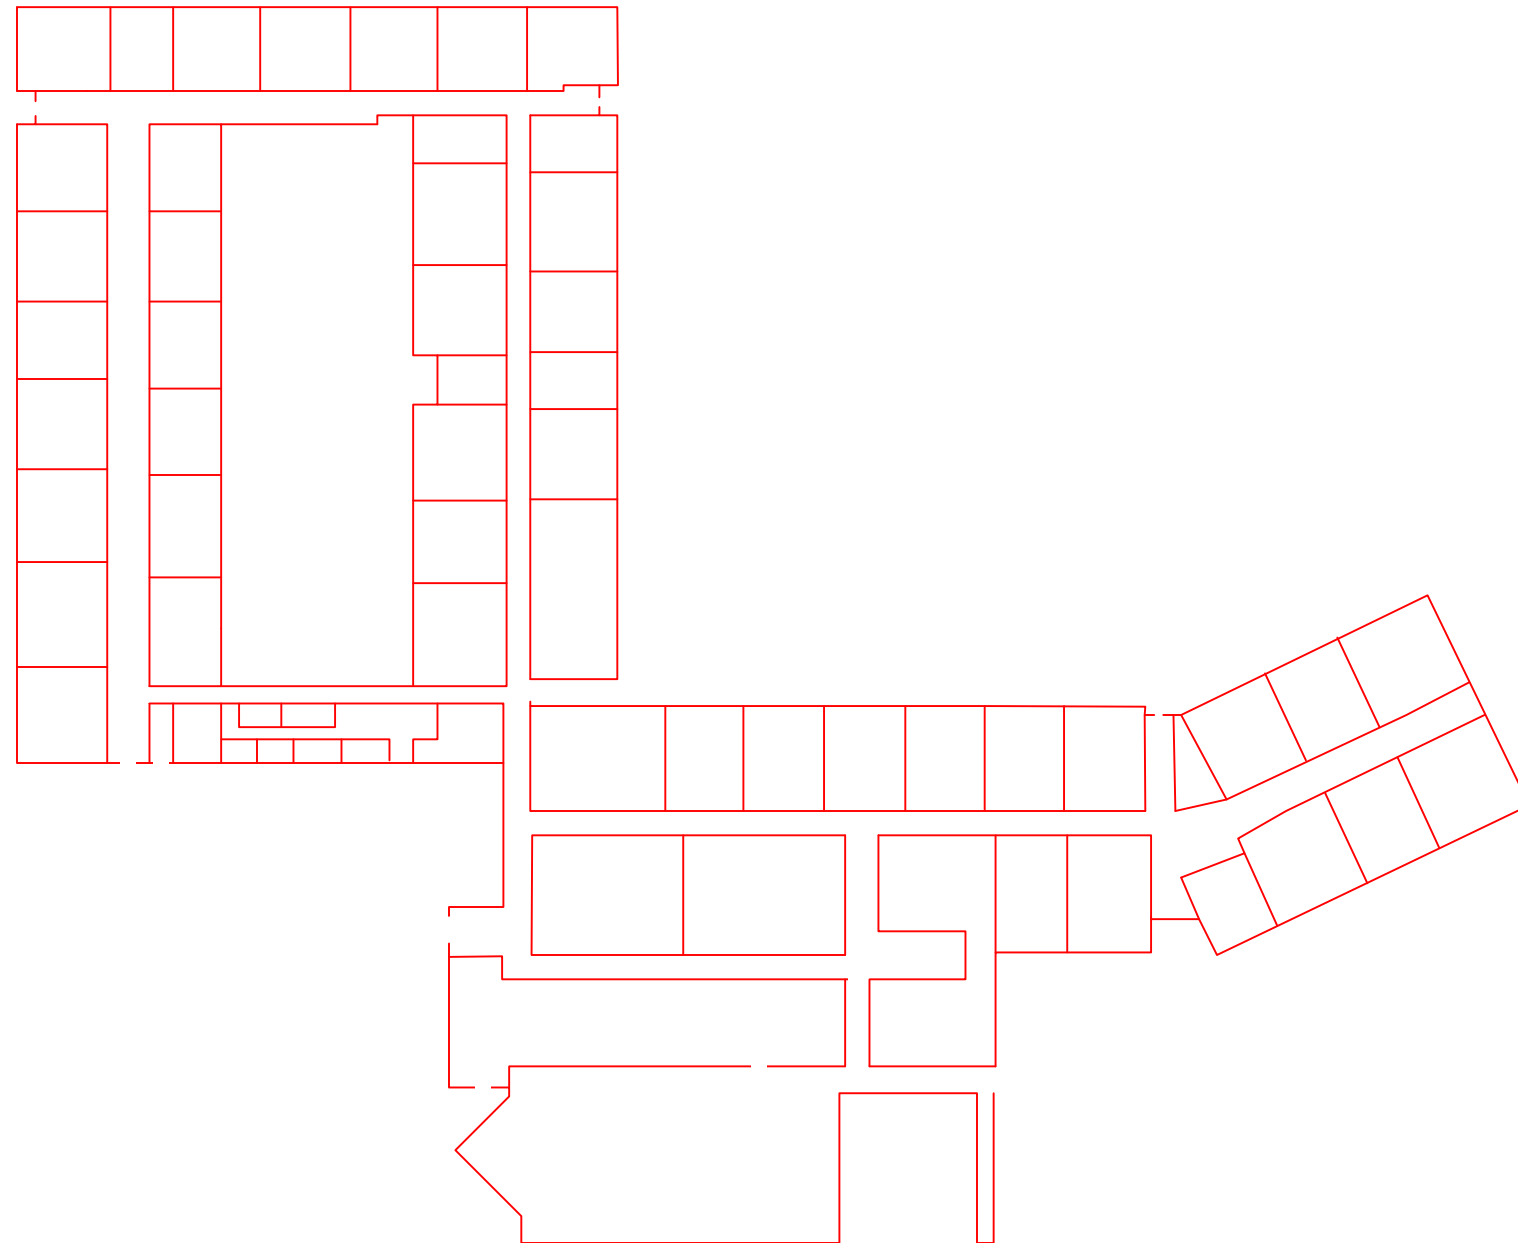

Elementary School



Candor Schools Candor, New York			
AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE © CONTRACTOR			
Page-25			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
AUTOMATEDLOGIC® CORPORATION			CHECK BY: RSL DSCODE: 07112.00
25 of 26			

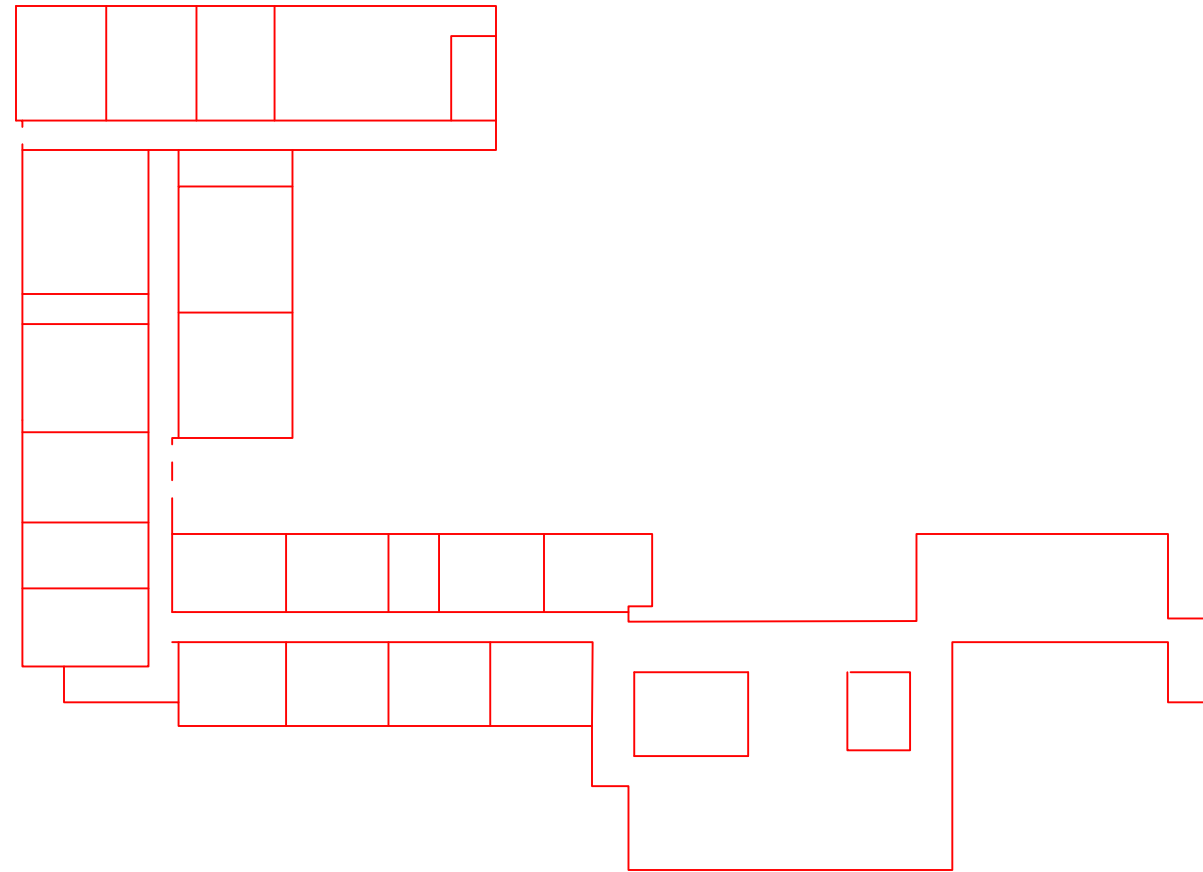High School Second Floor



Candor Schools Candor, New York			
 AIR TEMP HEATING & AIR CONDITIONING, INC. A LINC SERVICE © CONTRACTOR			
Page-26			
REV: 1	Submittal	9/29/2008	JOB NO: P7793
			CHECK BY: RSL
			DSCODE: 07112.00
			26 of 26